

**CLIENT:** Cosentino  
355 Alhambra Circle, 10<sup>th</sup> floor  
Coral Gables, FL 33134

**Project No:** 20-2127

**Report Date:** March 8, 2021

**SAMPLE ID:** Series: 1.2 cm Dekton Ultra Compact Facade Systems

**SAMPLE DESCRIPTION:** 21'-0 3/8" (252 3/8") by 9'-3 3/8" (112 3/8") high; See page 4 for full description.

**SAMPLING DETAIL:** The test sample manufactured by Cosentino was submitted directly to FTL by the client. Samples were independently selected for testing.

**DATE OF RECEIPT:** Samples were received at the FTL Miami Laboratory on January 13, 2021.

**TESTING PERIOD:** January 20, 2021 to January 21, 2021.

**TESTING LOCATION:** Fenestration Testing Laboratory (FTL) – Miami, Florida, USA

**AUTHORIZATION:** Proposal 20AM05141, signed by Brendan Mercier, dated May 14, 2020.

**TEST PROCEDURE:** Testing to the following requirements:

- ASTM E330/E330M-14 Standard Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference

**TEST RESULTS:** The façade systems achieved passing results found within this test report when tested in accordance with the ASTM E330/E330M procedure B section 12.1.11.

**CONTENTS:** Test report pages 1 through 15.

**Prepared By**

*Lusinda Delgado*

**Lusinda Delgado**  
Technical Report Writer

**Signed for and on behalf of  
Fenestration Testing Laboratory**

*Jose Sanchez*

**Jose Sanchez**  
Operation Manager

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Table of Contents	Page	Rev	Results Sample A-2	Page	Rev
Revision Table	3	1	Design Load Test Negative	ASTM E330	10
Notes Table	3		Design Load Test Negative	ASTM E330	10
Remarks Table	3		Design Load Test Negative	ASTM E330	10
<b>Sample A-1, A-2, A-3</b>			Design Load Test Negative	ASTM E330	10
Description of Test Sample	4		Design Load Test Negative	ASTM E330	10
Additional Information	4		Design Load Test Negative	ASTM E330	11
Test Sample Installation	4		Design Load Test Negative	ASTM E330	11
Results Sample A-1			Design Load Test Negative	ASTM E330	11
Design Load Test Positive	ASTM E330	4	Design Load Test Negative	ASTM E330	11
Design Load Test Positive	ASTM E330	4	Design Load Test Negative	ASTM E330	11
Design Load Test Positive	ASTM E330	4	Design Load Test Negative	ASTM E330	12
Design Load Test Positive	ASTM E330	5	Design Load Test Negative	ASTM E330	12
Design Load Test Positive	ASTM E330	5	Results Sample A-3		1
Design Load Test Positive	ASTM E330	5	Design Load Test Negative	ASTM E330	13
Design Load Test Positive	ASTM E330	5	Design Load Test Negative	ASTM E330	13
Design Load Test Positive	ASTM E330	5	Design Load Test Negative	ASTM E330	13
Design Load Test Positive	ASTM E330	6	Design Load Test Negative	ASTM E330	13
Design Load Test Positive	ASTM E330	6	Design Load Test Negative	ASTM E330	13
Design Load Test Positive	ASTM E330	6	Design Load Test Negative	ASTM E330	14
Design Load Test Positive	ASTM E330	6	Design Load Test Negative	ASTM E330	14
Design Load Test Negative	ASTM E330	7	Design Load Test Negative	ASTM E330	14
Design Load Test Negative	ASTM E330	7	Design Load Test Negative	ASTM E330	14
Design Load Test Negative	ASTM E330	7	Design Load Test Negative	ASTM E330	14
Design Load Test Negative	ASTM E330	7	Design Load Test Negative	ASTM E330	15
Design Load Test Negative	ASTM E330	7	Design Load Test Negative	ASTM E330	15
Design Load Test Negative	ASTM E330	8	Appendix A		15
Design Load Test Negative	ASTM E330	8	Appendix B		15
Design Load Test Negative	ASTM E330	8			
Design Load Test Negative	ASTM E330	8			
Design Load Test Negative	ASTM E330	9			

Technician:  
Yoenis Gonzalez

Revision	Description	Effective Date
0	Initial Release	3/8/2021
1	Included 210. psf pressures	5/12/2021

Notes
<p>* designates measurements by laboratory            ** as per manufacturer</p> <p>Fenestration Testing Laboratory Inc., does not have, nor does it intend to acquire or will acquire, a financial interest in any company manufacturing or distributing products tested or labeled by the Fenestration Testing Laboratory Inc. Fenestration Testing Laboratory Inc., is not owned, operated or controlled by any company manufacturing or distributing products it tests or labels.</p> <p>Drawings referenced in this document are an integral part of this report, therefore, are required when distributing this test report. Test results obtained represent the actual value of the tested specimens and do not constitute opinion, endorsement or certification by this laboratory.</p> <p>Test loads were held for 10 seconds.</p> <p>At conclusion of testing there was no visible damage to stone wall or fasteners withdrawal from the assembly.</p> <p>Test specimens were covered with 1.5 mil plastic sheeting to seal from air leakage when load test were performed, however this had no effect on below results.</p>

Remarks
<p>Detailed drawings and digital video disc of testing will be retained by Fenestration Testing Laboratory for a period of five years from the original test date, and test report for a period of ten years.</p>

DESCRIPTION OF SAMPLE	
Model Designation:	Series: 1.2 cm Dekton Ultra Compact Facade Systems
Overall Size:	21'-0 3/8" (252 3/8") by 9'-3 3/8" (112 3/8") high
Number of Panels:	Four
Size of Panels:	10'-6" (126") by 4'-8" (56") high
Sample A-1	

Additional Information
The sample was tested using one 5/16-18 HWH machine screw located on the Gridwork Ultra dead anchor, first row of each panel. The screws were located at 1/4" points of the panel.

Sample Installation
The panels were installed onto a 14-gauge steel studded wall that has a 5/8" Densglass board. One Gridwork Ultra wind load anchor located horizontally, spaced 26" on center and fastened to the wall using a single row of No. 14 by 3" HWH SDS plastic shim spaced 16" on center. The panels engage onto the Gridwork Ultra deadload anchor. The Gridwork Ultra anchor was located horizontally behind each panel and was fastened using a single row of **Keli F352 undercut fastener with locking plate and **Grid Loc STAP adhesive applied continuously to the back of the ultra-anchor spaced 40" on center.

Sample: A-1	Temperature: 76.1°F	Barometric Reading: 30.0 inches Hg		
Title of Test		Pressure	Notes	
Design Load Test Positive Load		15.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.041"	0.006"	Passed	
2	0.059"	0.001"	Passed	
3	0.068"	0.004"	Passed	

Sample: A-1	Temperature: 76.1°F	Barometric Reading: 30.0 inches Hg		
Title of Test		Pressure	Notes	
Design Load Test Positive Load		30.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.092"	0.011"	Passed	
2	0.124"	0.010"	Passed	
3	0.141"	0.021"	Passed	

Sample: A-1	Temperature: 76.1°F	Barometric Reading: 30.0 inches Hg		
Title of Test		Pressure	Notes	
Design Load Test Positive Load		45.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.140"	0.015"	Passed	
2	0.175"	0.017"	Passed	
3	0.207"	0.035"	Passed	

Sample: A-1	Temperature:	76.1°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		60.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.201"	0.026"	Passed	
2	0.231"	0.024"	Passed	
3	0.274"	0.045"	Passed	

Sample: A-1	Temperature:	76.1°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		75.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.271"	0.041"	Passed	
2	0.289"	0.027"	Passed	
3	0.342"	0.052"	Passed	

Sample: A-1	Temperature:	76.1°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		90.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.342"	0.051"	Passed	
2	0.363"	0.048"	Passed	
3	0.411"	0.063"	Passed	

Sample: A-1	Temperature:	76.1°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		120.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.485"	0.098"	Passed	
2	0.502"	0.100"	Passed	
3	0.514"	0.094"	Passed	

Sample: A-1	Temperature:	76.1°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		135.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.552"	0.118"	Passed	
2	0.567"	0.122"	Passed	
3	0.555"	0.107"	Passed	

Sample: A-1	Temperature:	76.1°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		150.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.612"	0.138"	Passed	
2	0.603"	0.141"	Passed	
3	0.582"	0.124"	Passed	

Sample: A-1	Temperature:	76.1°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		180.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.691"	0.160"	Passed	
2	0.662"	0.151"	Passed	
3	0.638"	0.132"	Passed	

Sample: A-1	Temperature:	76.1°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		210.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.745"	0.196"	Passed	
2	0.732"	0.191"	Passed	
3	0.701"	0.162"	Passed	

Sample: A-1	Temperature:	76.1°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		240.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.792"	0.210"	Passed	
2	0.788"	0.200"	Passed	
3	0.772"	0.173"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		15.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.056"	0.020"	Passed	
2	0.068"	0.016"	Passed	
3	0.073"	0.022"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		30.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.127"	0.031"	Passed	
2	0.247"	0.045"	Passed	
3	0.201"	0.057"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		45.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.179"	0.048"	Passed	
2	0.279"	0.060"	Passed	
3	0.316"	0.083"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		60.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.212"	0.068"	Passed	
2	0.346"	0.073"	Passed	
3	0.423"	0.085"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		75.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.272"	0.081"	Passed	
2	0.417"	0.098"	Passed	
3	0.596"	0.087"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		90.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.345"	0.096"	Passed	
2	0.495"	0.119"	Passed	
3	0.755"	0.090"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		105.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.346"	0.105"	Passed	
2	0.520"	0.132"	Passed	
3	0.801"	0.092"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		120.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.560"	0.135"	Passed	
2	0.842"	0.156"	Passed	
3	1.128"	0.122"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		135.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.588"	0.141"	Passed	
2	1.585"	0.162"	Passed	
3	1.402"	0.170"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		150.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.658"	0.159"	Passed	
2	1.708"	0.178"	Passed	
3	1.568"	0.186"	Passed	



Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		180.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.701"	0.170"	Passed	
2	1.806"	0.186"	Passed	
3	1.659"	0.198"	Passed	

Sample: A-1	Temperature:	74.0°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		210.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.686"	0.132"	Passed	
2	1.588"	0.162"	Passed	
3	1.520"	0.143"	Passed	

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		15.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.063"	0.008"	Passed	
2	0.075"	0.010"	Passed	
3	0.078"	0.011"	Passed	

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		30.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.118"	0.015"	Passed	
2	0.215"	0.018"	Passed	
3	0.190"	0.016"	Passed	

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		45.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.165"	0.021"	Passed	
2	0.280"	0.026"	Passed	
3	0.269"	0.025"	Passed	

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		60.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.208"	0.035"	Passed	
2	0.325"	0.050"	Passed	
3	0.296"	0.042"	Passed	

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		75.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.261"	0.058"	Passed	
2	0.390"	0.069"	Passed	
3	0.376"	0.065"	Passed	

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		90.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.338"	0.071"	Passed	
2	0.459"	0.089"	Passed	
3	0.431"	0.086"	Passed	

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		105.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.362"	0.076"	Passed	
2	0.499"	0.098"	Passed	
3	0.490"	0.092"	Passed	

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		120.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.480"	0.090"	Passed	
2	0.733"	0.115"	Passed	
3	0.711"	0.102"	Passed	

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		135.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.562"	0.096"	Passed	
2	1.208"	0.128"	Passed	
3	1.113"	0.123"	Passed	

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		150.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.611"	0.126"	Passed	
2	1.516"	0.158"	Passed	
3	1.490"	0.140"	Passed	

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		180.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.719"	0.132"	Passed	
2	1.628"	0.163"	Passed	
3	1.590"	0.150"	Passed	

Sample: A-2	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		210.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.745"	0.139"	Passed	
2	1.702"	0.170"	Passed	
3	1.618"	0.158"	Passed	

Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		15.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.069"	0.005"	Passed	
2	0.086"	0.011"	Passed	
3	0.081"	0.009"	Passed	

Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		30.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.138"	0.018"	Passed	
2	0.256"	0.025"	Passed	
3	0.228"	0.023"	Passed	

Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		45.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.173"	0.025"	Passed	
2	0.295"	0.042"	Passed	
3	0.283"	0.038"	Passed	

Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		60.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.196"	0.029"	Passed	
2	0.342"	0.056"	Passed	
3	0.326"	0.045"	Passed	

Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		75.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.258"	0.035"	Passed	
2	0.386"	0.066"	Passed	
3	0.368"	0.062"	Passed	

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		90.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.326"	0.042"	Passed	
2	0.468"	0.069"	Passed	
3	0.442"	0.065"	Passed	

Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		105.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.382"	0.049"	Passed	
2	0.526"	0.078"	Passed	
3	0.508"	0.070"	Passed	

Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		120.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.496"	0.081"	Passed	
2	0.890"	0.102"	Passed	
3	0.871"	0.090"	Passed	


Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		135.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.584"	0.088"	Passed	
2	1.311"	0.126"	Passed	
3	1.206"	0.109"	Passed	

Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		150.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.638"	0.099"	Passed	
2	1.539"	0.146"	Passed	
3	1.502"	0.138"	Passed	


Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		180.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.738"	0.115"	Passed	
2	0.696"	0.170"	Passed	
3	1.580"	0.161"	Passed	

Sample: A-3	Temperature:	74.4°F	Barometric Reading: 30.1 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		210.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.742"	0.118"	Passed	
2	0.780"	0.176"	Passed	
3	1.629"	0.168"	Passed	

Appendix A

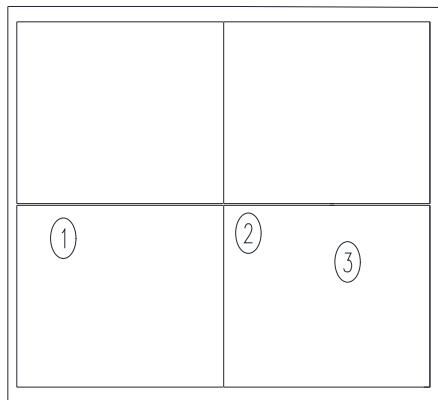

Appendix B

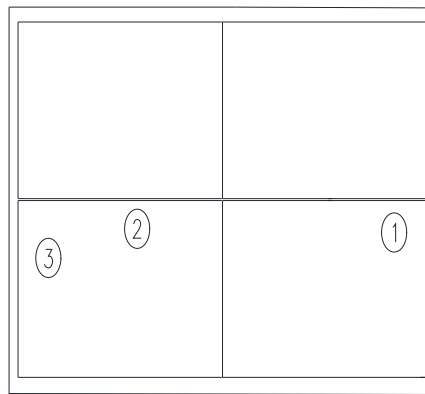

SPECIFICATIONS:

GRIDWORX FAMILY OF ANCHORS:  
ALUMINUM ALLOY EXTRUSIONS WITH A COMPOSITION OF 6005 ALLOW WITH A T5 TEMPER. CHANNELS PROVIDED IN TWELVE FOOT (12') LENGTHS. "L BRACKETS" ARE SPECIFIED IN LENGTH BY THE CURTAIN WALL ENGINEER AND SET AT 1/4 POINTS OF PANEL WIDTH. ALUMINUM COMPONENTS OF THE GRIDWORX SYSTEM ARE ANODIZED WITH A CLEAR COAT OR WITH COLORED FINISHES OF AA M12C22A21 MEETING THE STANDARDS OF AAMA 611-98.

FASTENERS:

- **STEEL STUDS:**  
ELCO DRILL-FLEX OR HILTI KWIK-FLEX FASTENERS, #12 x 2" SELF DRILLING STRUCTURAL FASTENERS - SAE J 429 / GRADE 5 WITH A STALGARD COATING. INSTALLATION TO BE ON STUDS WITH MINIMUM OF 18 GAUGE SET ON 12" CENTERS.
- **CMU OR CONCRETE:**  
ELCO AGGRE-GATOR 300 SERIES STAINLESS STEEL THREADED CONCRETE ANCHOR, HEX HEAD, #12 x 2 1/4". INSTALLATION OF FASTENERS FOR THE "INTERMEDIATE T" TO BE ON 16" CENTERS WITH TOP AND BOTTOM SCREW TO ALTERNATE SO AS TO NOT HAVE BOTH INVADING THE SAME CAVITY OF THE CMU BLOCK. "TOP J AND STARTER J" TO BE INSTALLED ON 16" CENTERS.
- **WOOD STUDS:**  
STAINLESS STEEL 300, HEX HEAD, #12 x 2". TO BE INSTALLED ON 2" x 6" STUDS SET ON 16" CENTERS.

SHIMS:

FULL BEARING HI-IMPACT RESISTANT PLASTIC OF 3" VERTICAL OR GREATER.

SEALANT:


DOW CORNING 790 SILICONE (OR EQUAL) WITH 3/8" OPEN CELL BACKER ROD.

FLASHING:


- HOHMANN & BARNARD, INC. X-SEAL TAPE ADHESIVE (OR EQUAL)  
APPLIED CONTINUOUSLY BEHIND ANCHOR ONTO SHEATHING?WATEPROOF MEMBRANE TO CREATE WATERTIGHT SEAL AROUND FASTENERS.
- METAL AND/OR ASPHALT FLASHING.  
MATERIAL PROVIDED BY OTHERS FOR INTER-STORY, CASEMENT, BASE, AND OTHER RELEVANT FLASHING APPLICATIONS.

ABBREVIATIOINS:


- F.O.S = FACE OF STONE
- F.O.GL = FACE OF GLASS
- E.O.S. = EDGE OF STONE
- G.L. = GRID LINE
- JT. = JOINT




ITEM #: F206  
GRIDWORX 1/4" X 3" GRADE 5 STEEL FASTENER  
FINISH: STALGARD COATING  
MATERIAL: N/A




ITEM #: F505  
GRIDWORX 1/4" X 3" WOOD FASTENER  
FINISH: N/A  
MATERIAL: STAINLESS STEEL




ITEM #: F352  
GRIDWORX KEIL M8x14.5 UNDERCUT ANCHOR  
FINISH: N/A  
MATERIAL: N/A




ITEM #:  
GRIDWORX ULTRA PITCH ADJUSTMENT BOLT AND NUT  
FINISH: N/A  
MATERIAL: N/A

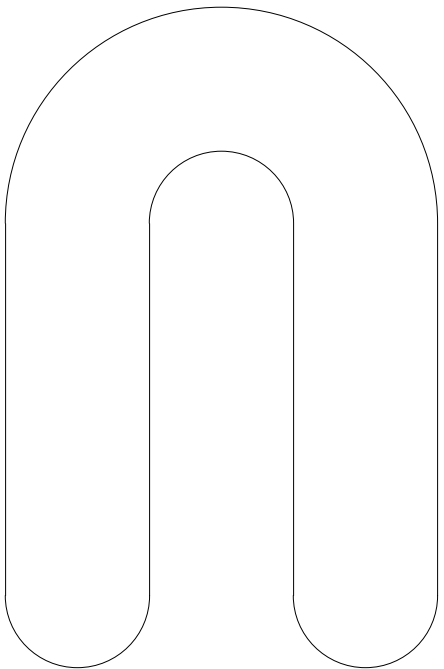

PART #S C100 1/16", C101 1/8", C102 1/4"  
FULL BEARING PLASTIC SHIM  
FINISH: N/A  
MATERIAL: HI-IMPACT PLASTIC

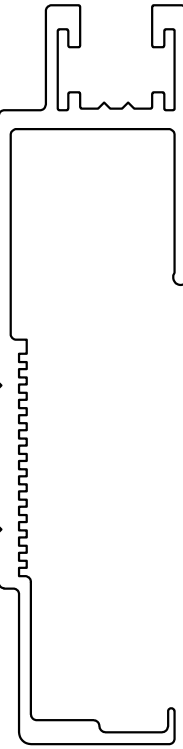


PART # 570  
GRIDWORX ULTRA 3.0 DEADLOAD ANCHOR  
FINISH: MILL FINISH  
MATERIAL: 6005 T5 ALUMINUM

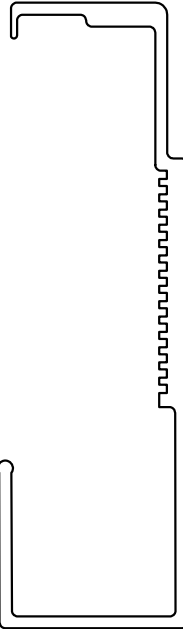

PART # 571  
GRIDWORX ULTRA 3.0 WINDLOAD ANCHOR  
FINISH: MILL FINISH  
MATERIAL: 6005 T5 ALUMINUM



PART # 575  
GRIDWORX ULTRA LOCKING PLATE  
FINISH: MILL FINISH  
MATERIAL: 6005 T5 ALUMINUM

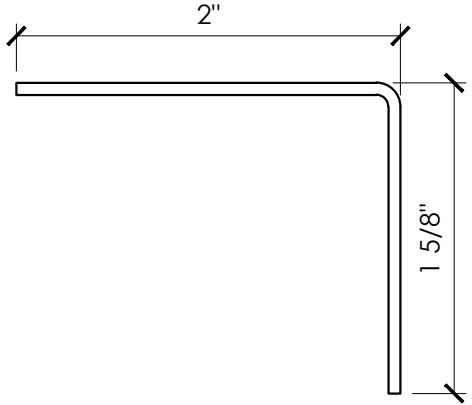

PART #  
GRIDWORX 16 GAUGE FORMED ALUMINUM ANGLE  
FINISH: MILL FINSH  
MATERIAL: 6005 T5 ALUMINUM

DRAWN BY:



PRECISION WALL SYSTEMS  
10980 ALDER CIRCLE  
DALLAS, TEXAS 75238

TEL: 214.774.4502  
FAX: 214.432.5963

ARCHITECT:  
N/A

PRECISION WALL SYSTEMS  
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:


SECTION DETAILS

SHEET:


ST1.00




COSENTINO NORTH AMERICA (MOCK UP #2)  
DEKTON ULTRA COMPACT PANEL FACADE SYSTEM  
NON IMPACT

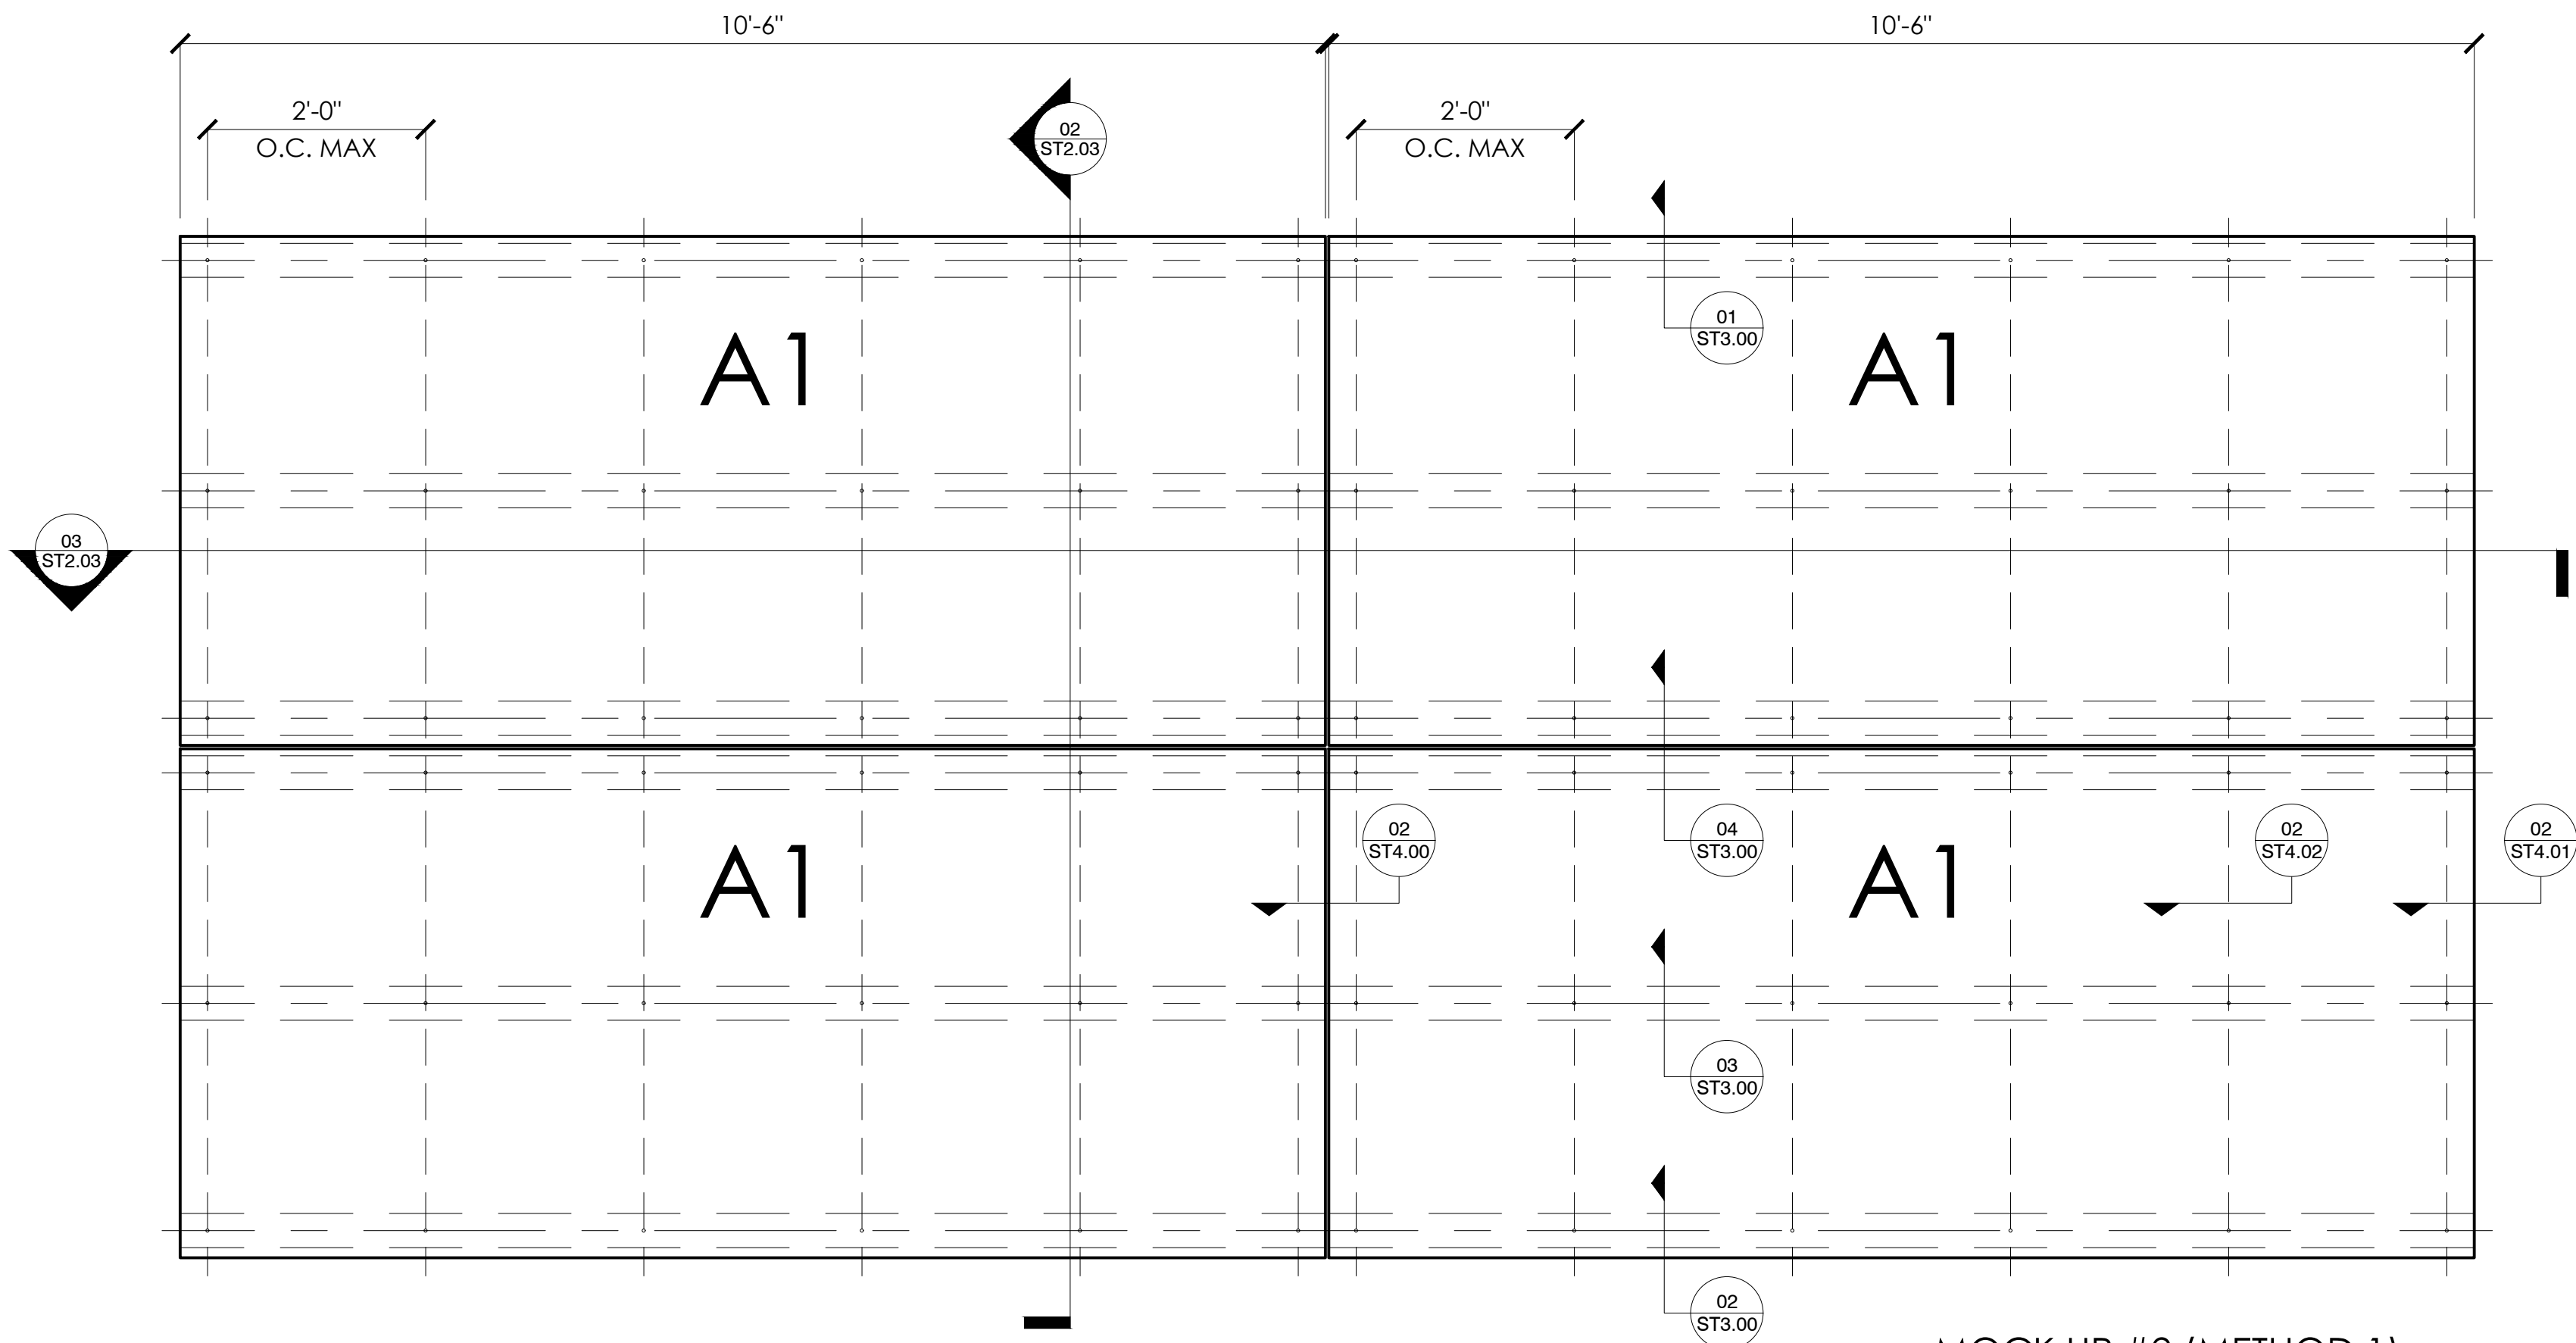

MOCK UP #2 (METHOD 1)  
STONE ELEVATION  
01  
ST2.03 ARCH. REF.: -  
SCALE: 3/4" = 1'-0"

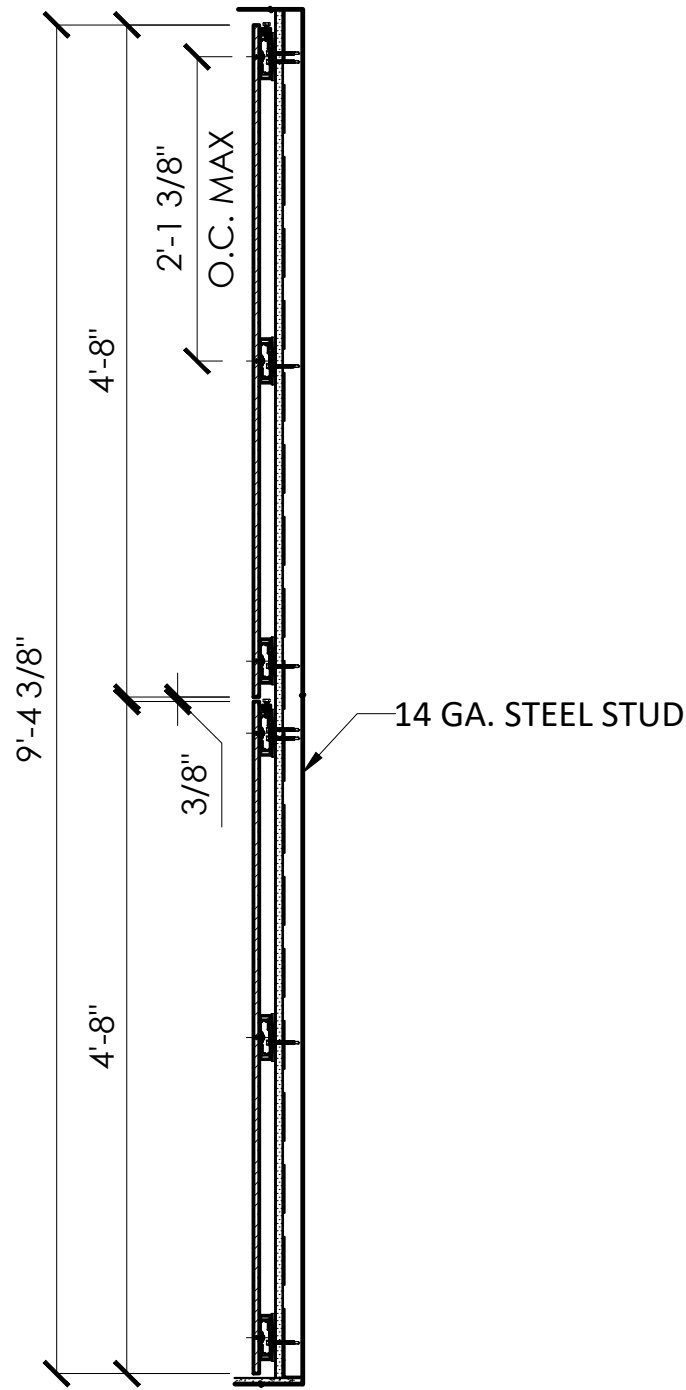

MOCK UP #2 (METHOD 1)  
SECTION VIEW  
02  
ST2.03 ARCH. REF.: -  
SCALE: 3/4" = 1'-0"

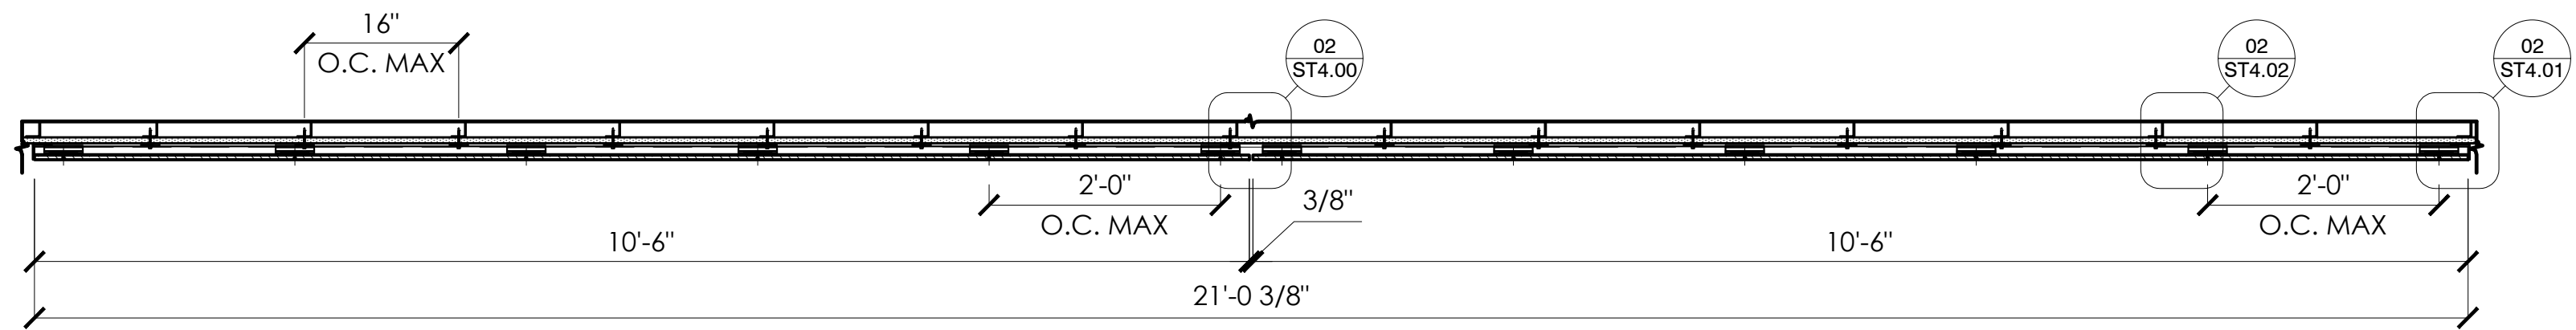

MOCK UP #2 (METHOD 1)  
PLAN VIEW  
03  
ST2.03 ARCH. REF.: -  
SCALE: 3/4" = 1'-0"

DRAWN BY:



PRECISION WALL SYSTEMS  
10980 ALDER CIRCLE  
DALLAS, TEXAS 75238

TEL: 214.774.4502  
FAX: 214.432.5963

ARCHITECT:  
N/A

PRECISION WALL SYSTEMS  
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:

ELEVATIONS,  
SECTION, AND PLANS

SHEET:

ST2.03

TESTS:  
UNIFORM LOAD (TAS 202) (LOADS ONLY)  
CYCLIC LOAD (TAS 203)  
SEE FLOWCHART FOR PRESSURES

DEKTON NOA TEST

-

STONE SHOP DRAWINGS


100% SET FOR REVIEW

SUBMITTAL #1 - SEPTEMBER 25, 2017

SUBMITTAL #2 - NOVEMBER 13, 2017

SUBMITTAL #3 - NOVEMBER 24, 2020 (ULTRA 3.0)


SHEET	DESCRIPTION
ST0.00	COVER PAGE
ST1.00	SPECIFICATION SHEET
ST2.00~ST2.05	ELEVATIONS, WALL SECTIONS, AND PLAN VIEWS
ST3.00~ST3.01	GRIDWORX RAIN SCREEN SECTION DETAILS
ST4.00~ST4.02	GRIDWORX RAIN SCREEN PLAN DETAILS

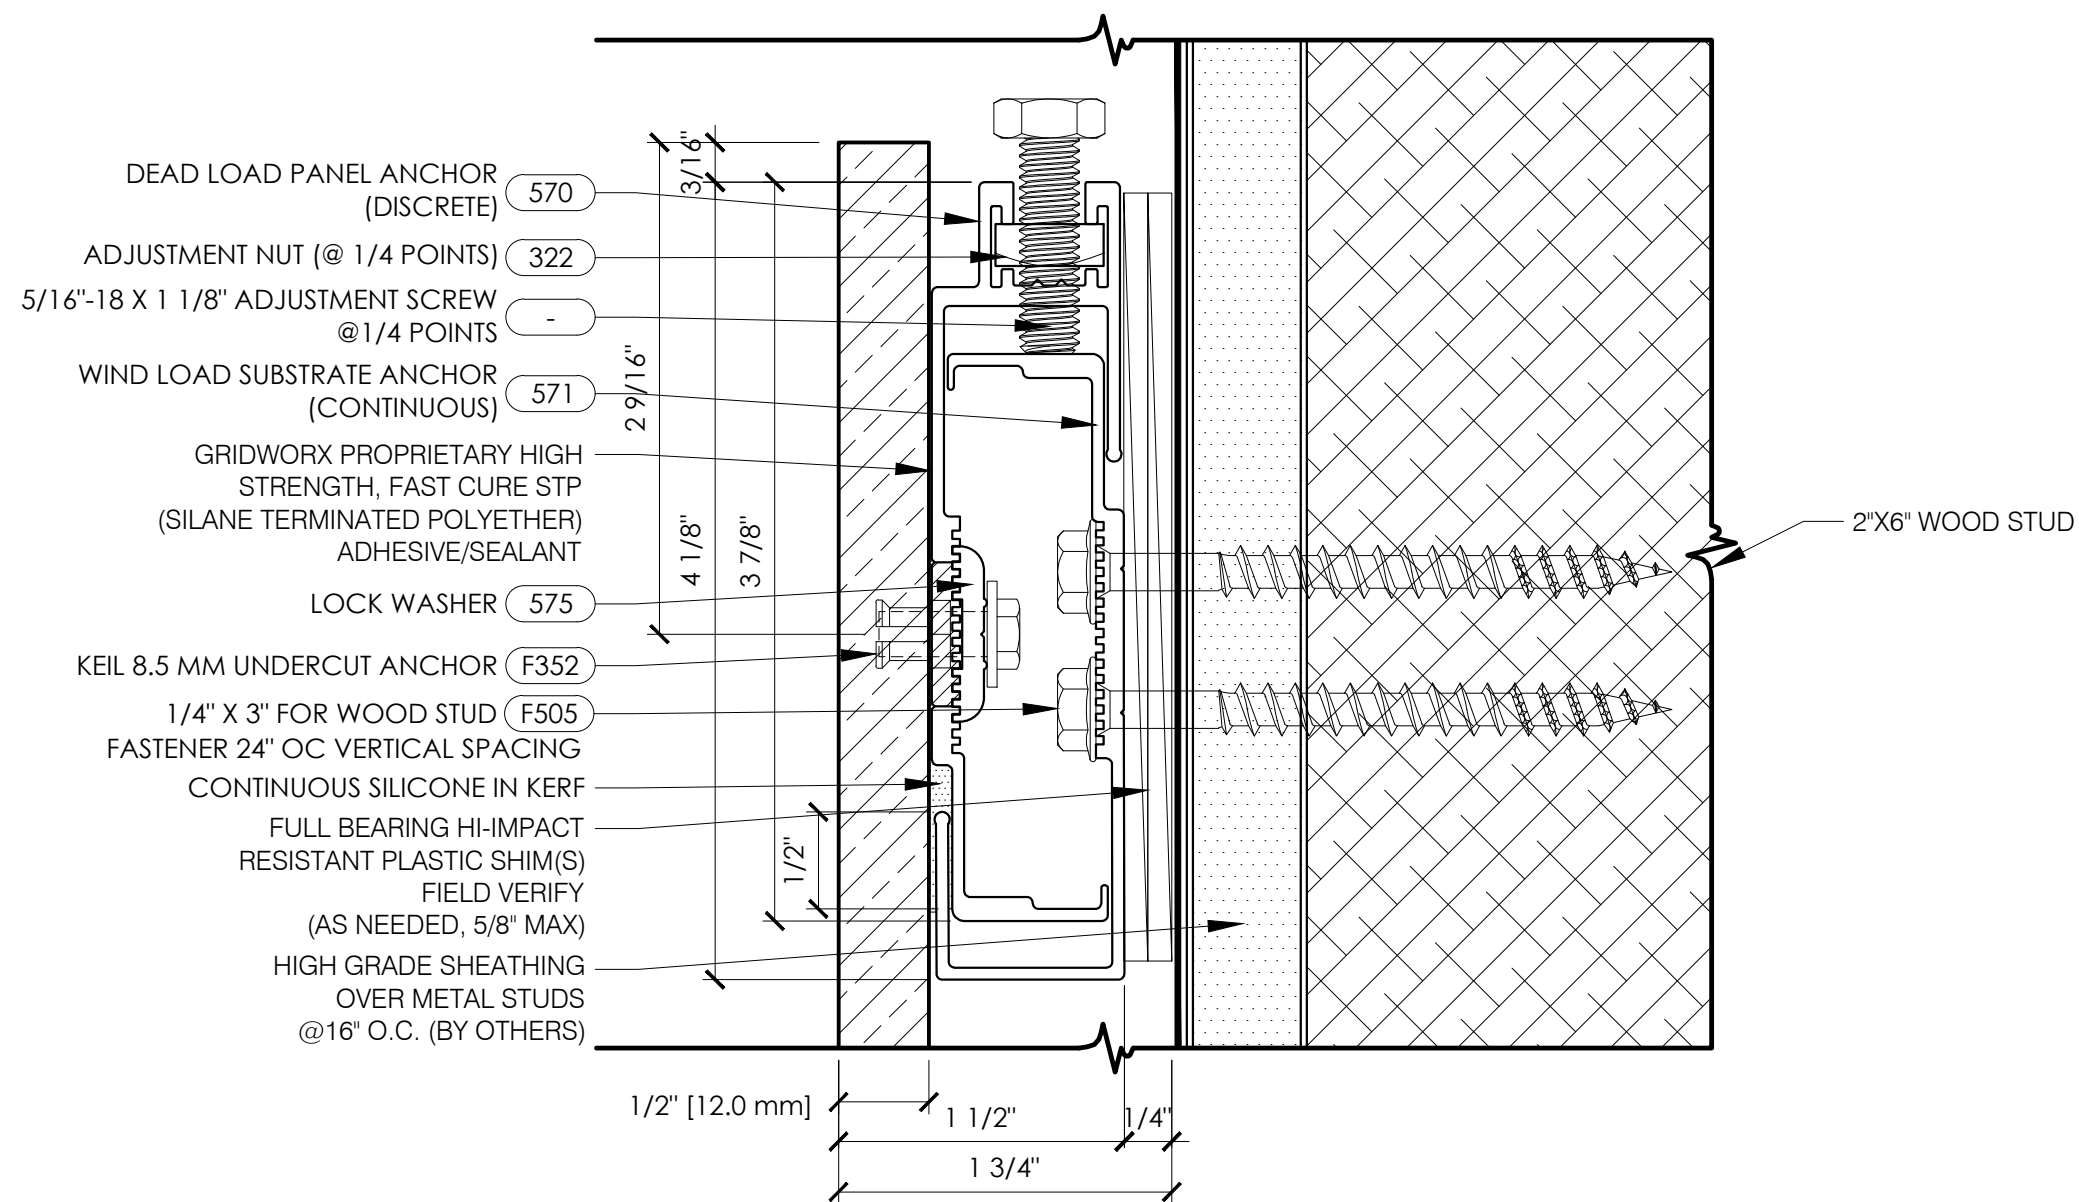

TOP ANCHOR  
WITH WOOD SUBSTRATE

01  
ST3.02


ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

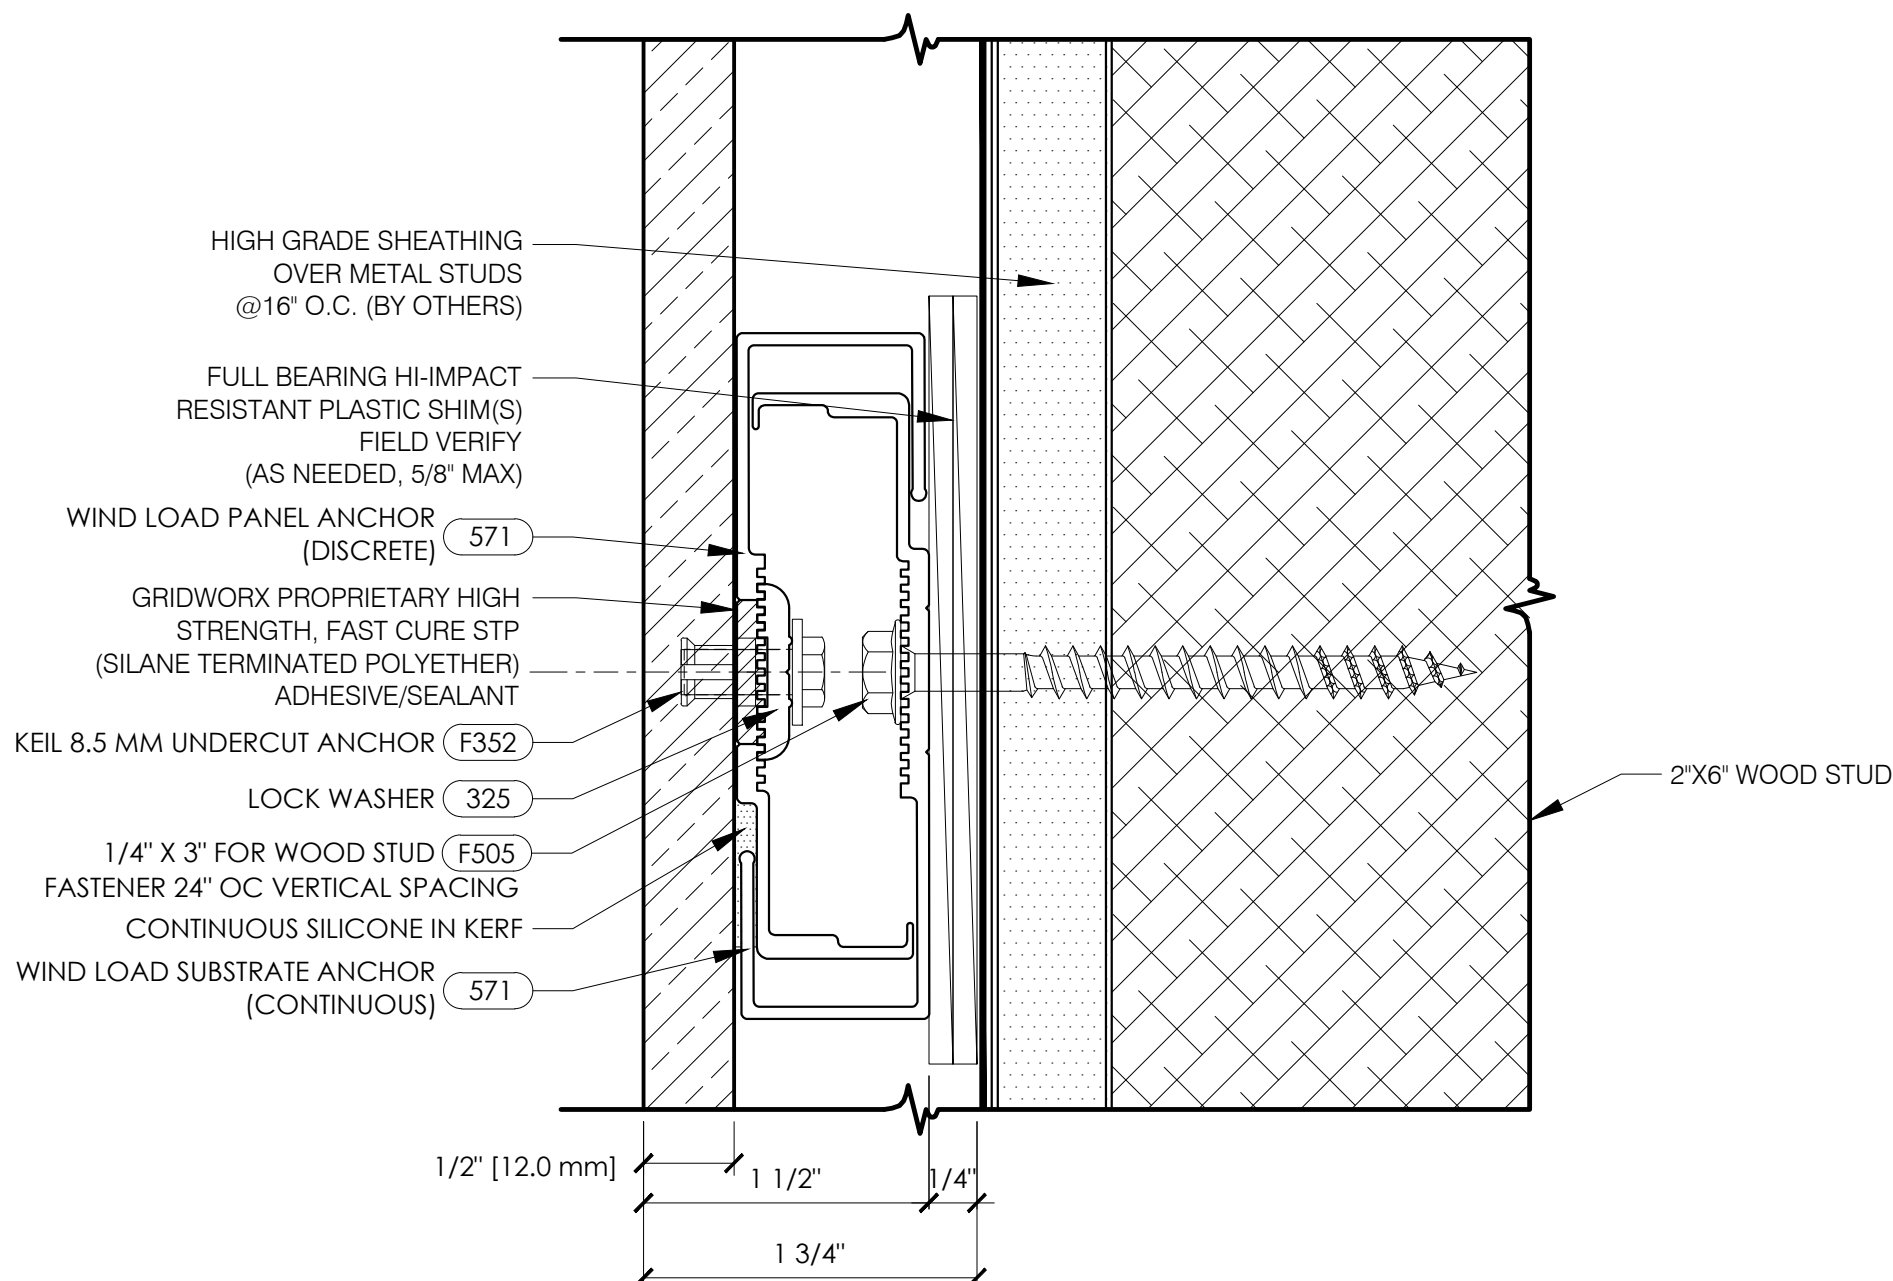

INTERMEDIATE SUPPORT  
WITH WOOD SUBSTRATE

03  
ST3.00


ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

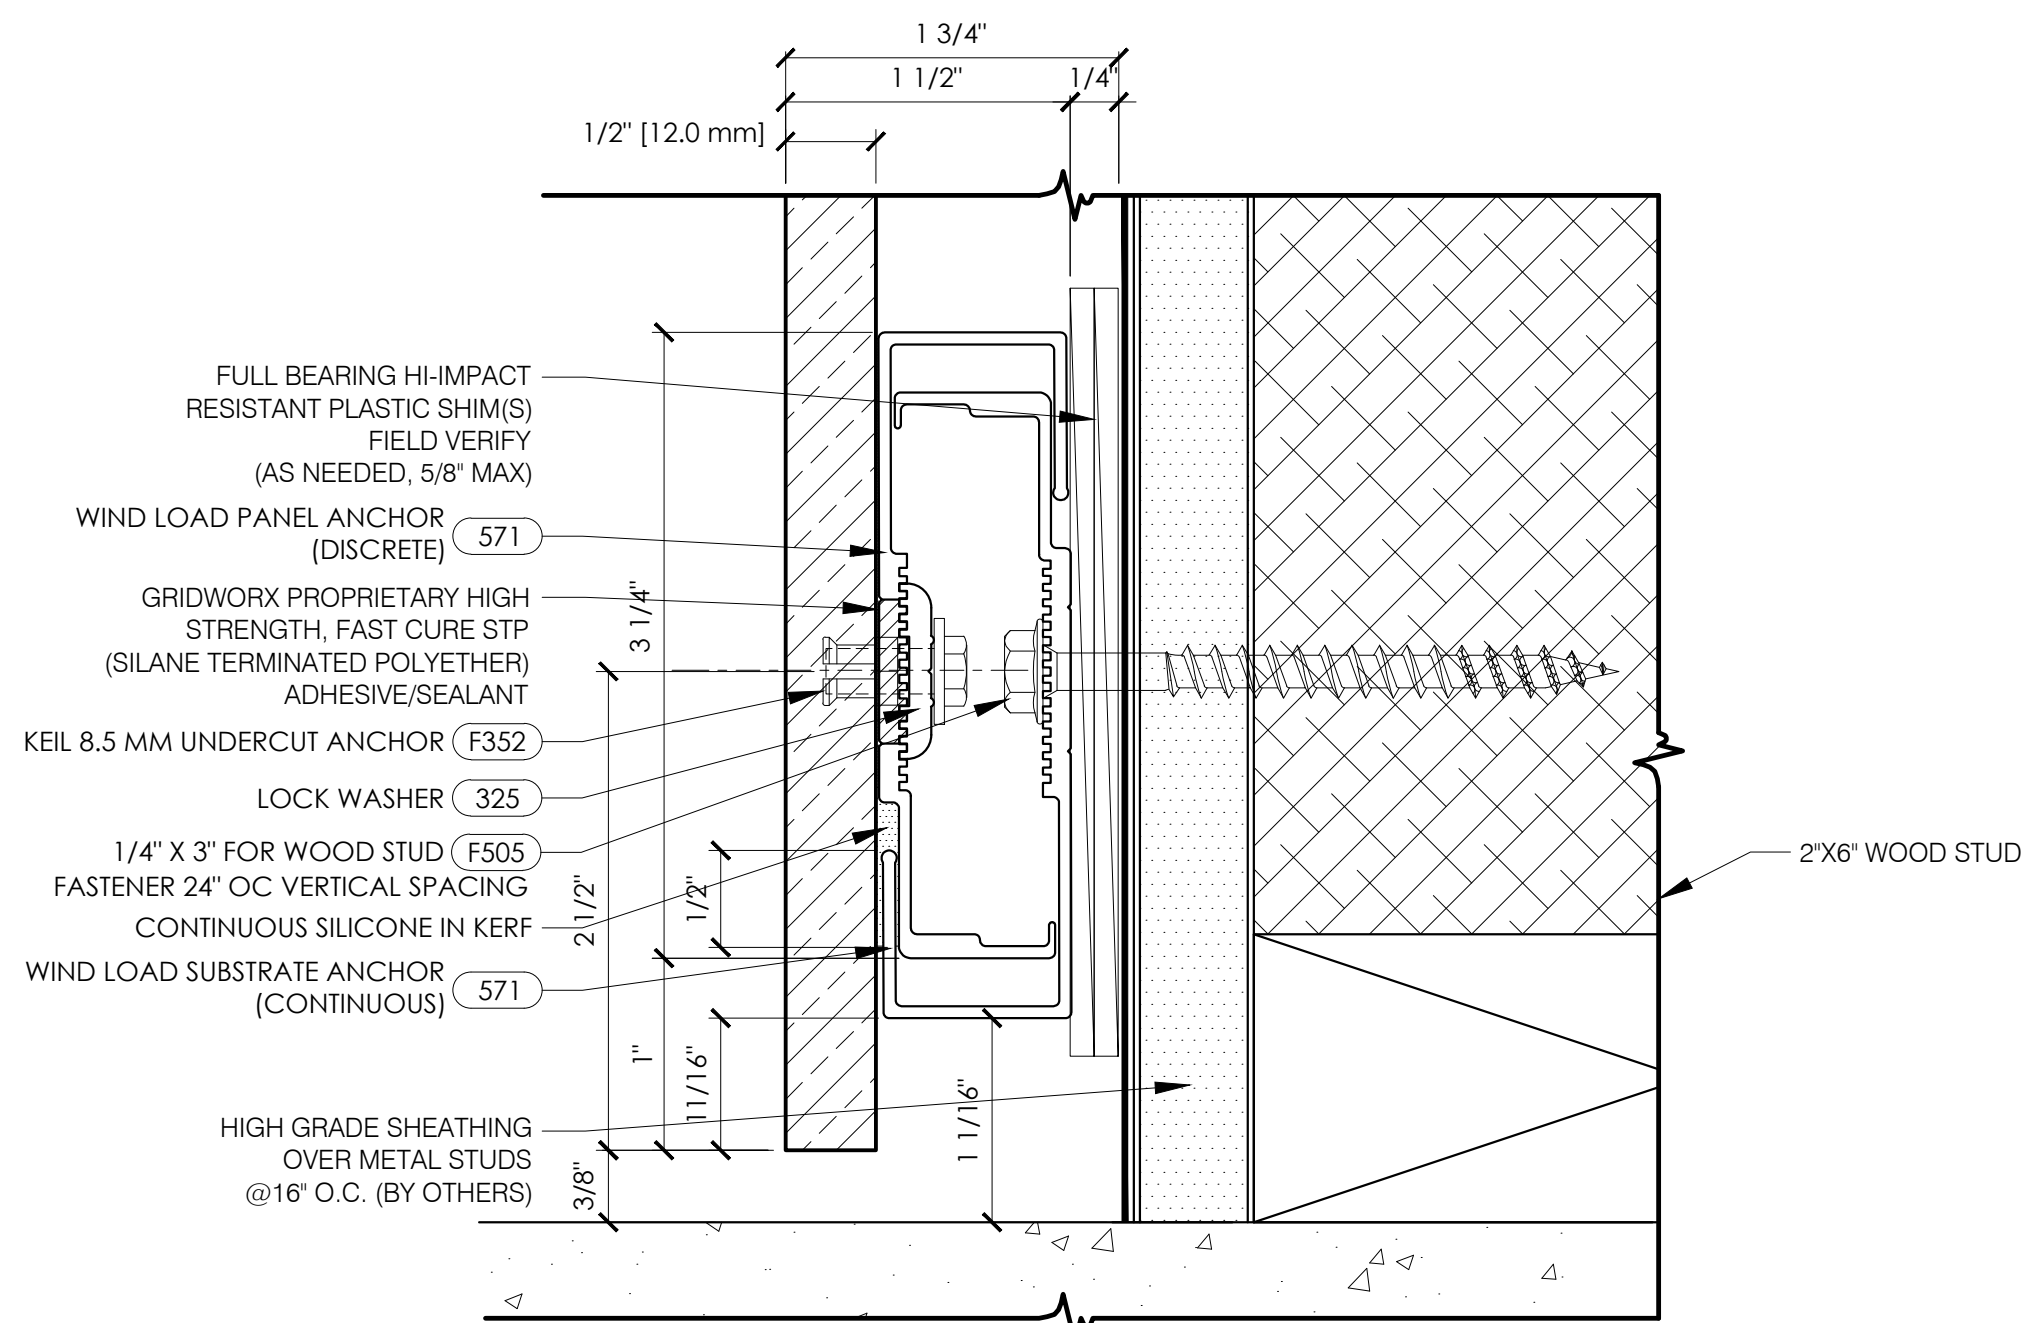

BOTTOM ANCHOR  
WITH WOOD SUBSTRATE

02  
ST3.00

ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

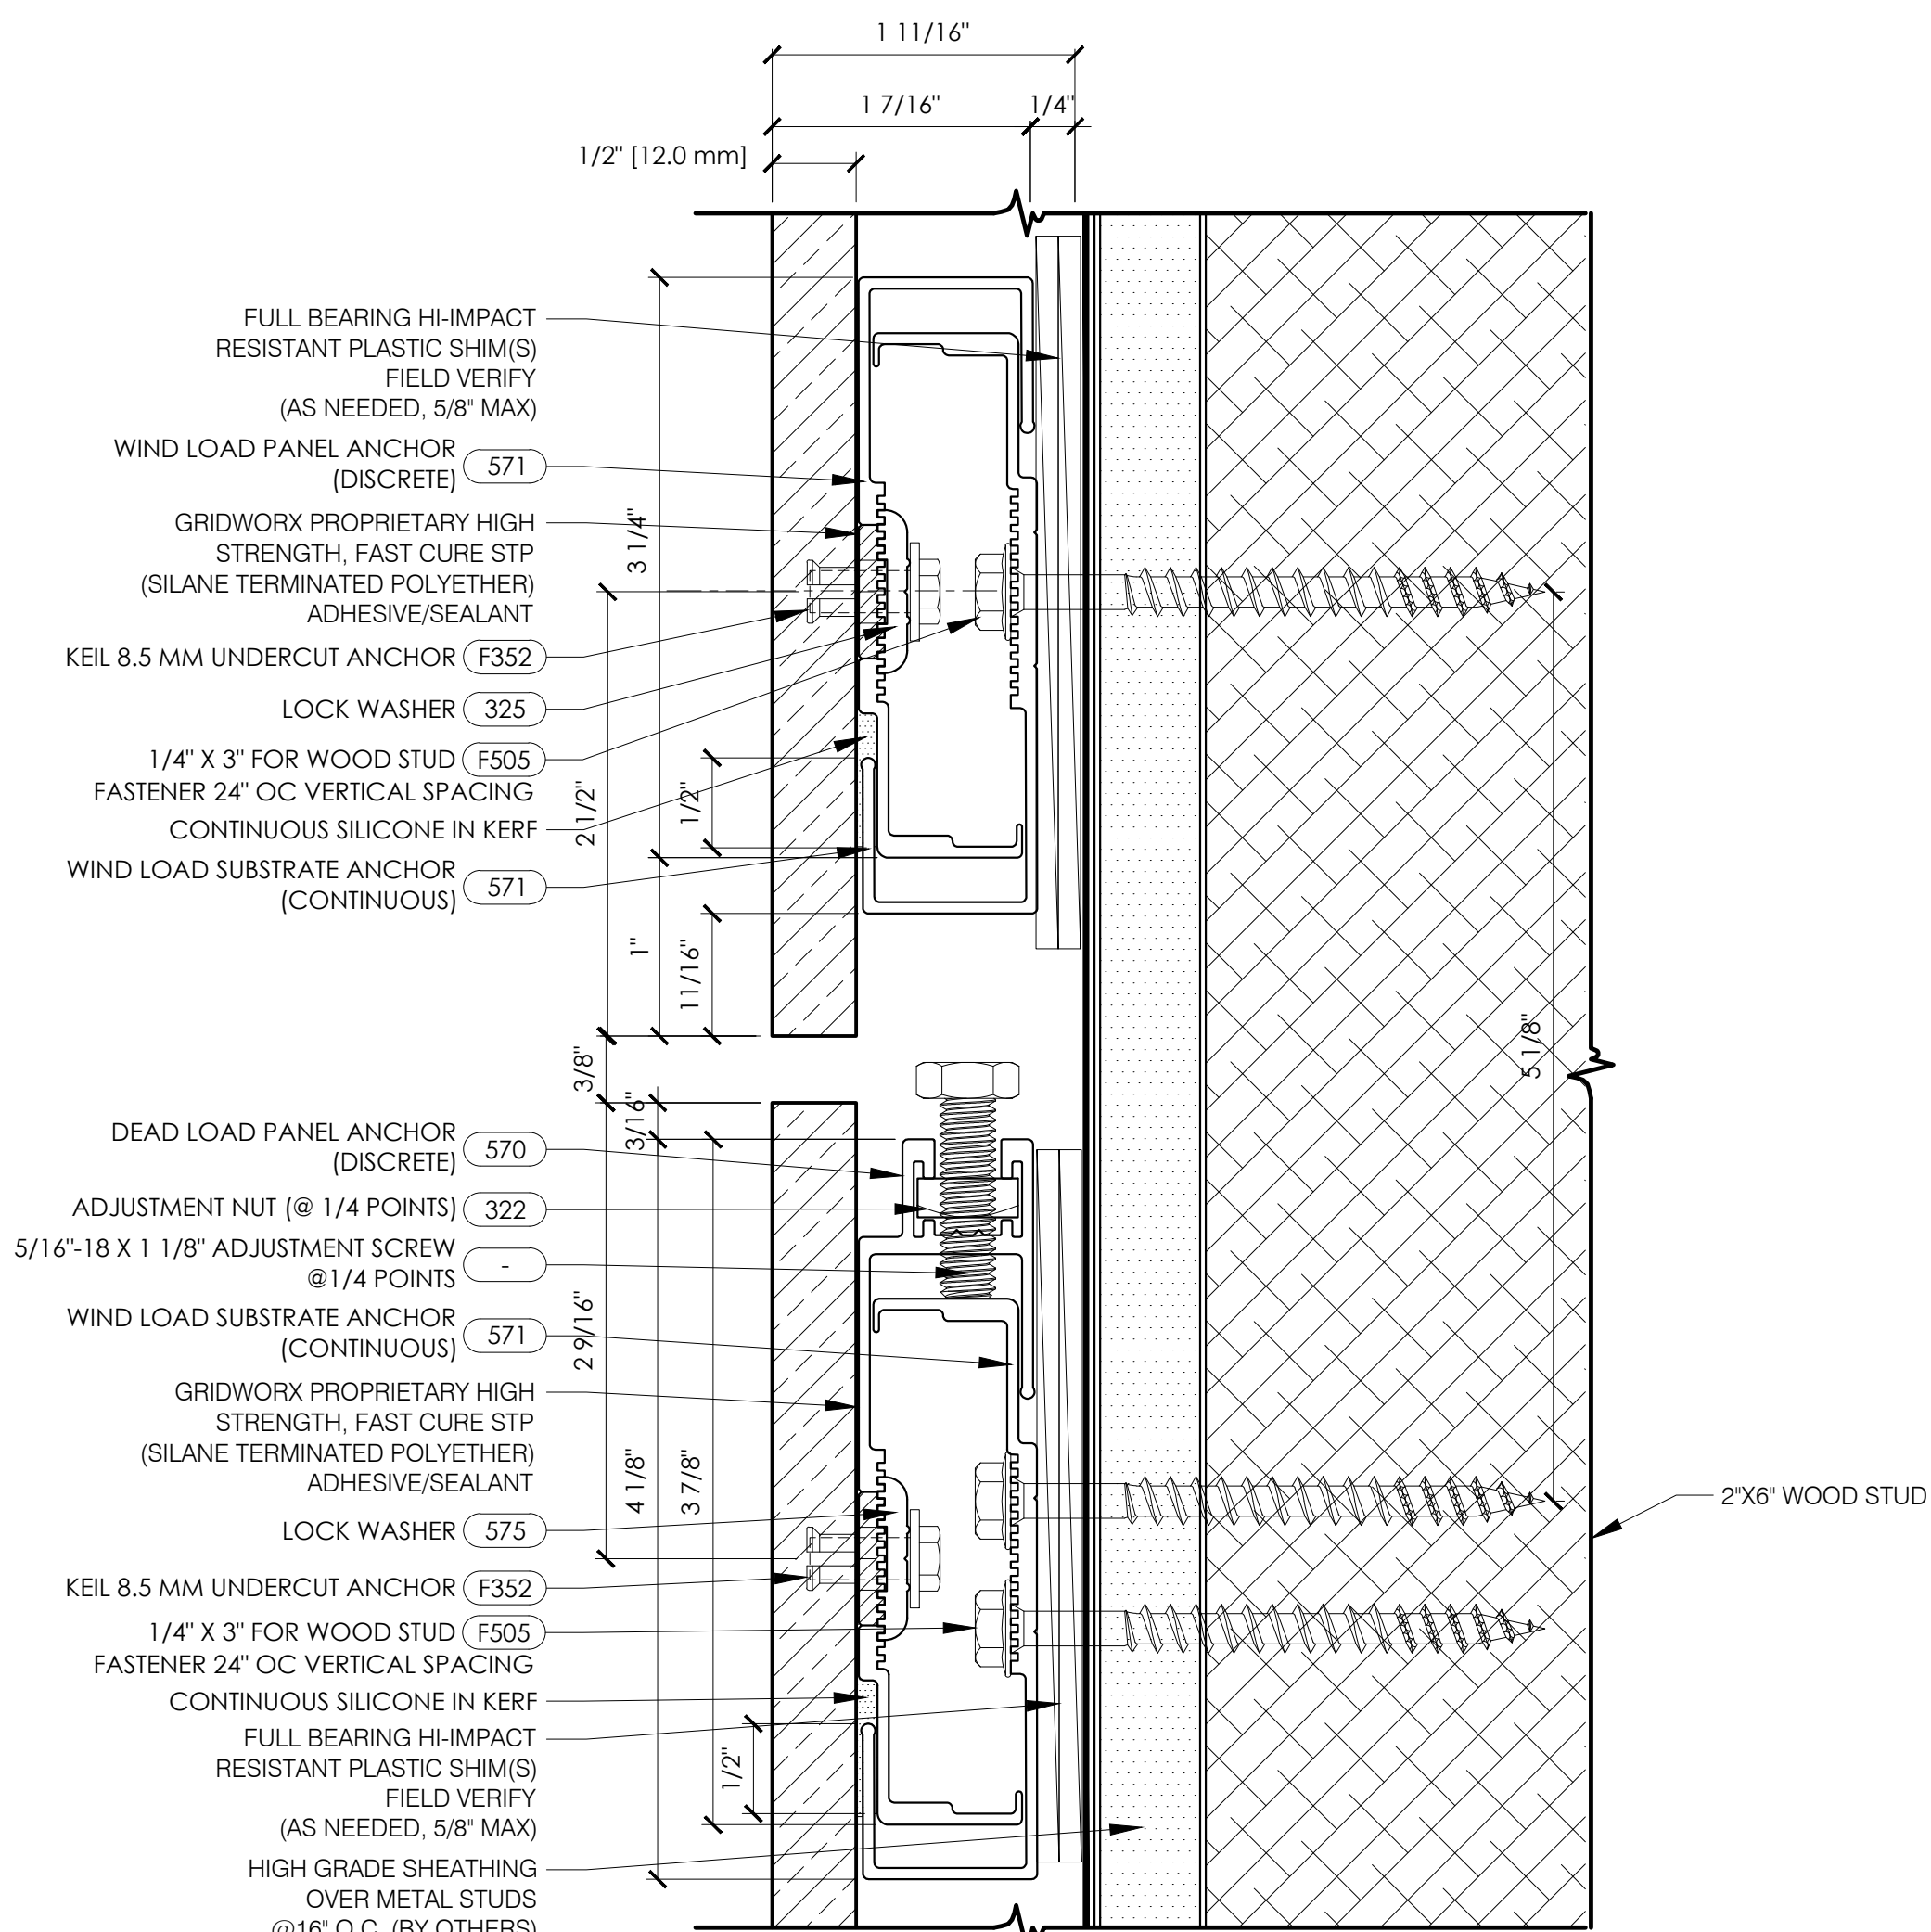

ANCHORS AT HORIZONTAL  
JOINT WITH WOOD SUBSTRATE

04  
ST3.00

ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

DRAWN BY:

**GRIDWORX**  
STONE HANGING SYSTEM

PRECISION WALL SYSTEMS  
10980 ALDER CIRCLE  
DALLAS, TEXAS 75238

TEL: 214.774.4502  
FAX: 214.432.5963

ARCHITECT:  
N/A

**PRECISION WALL SYSTEMS**  
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:


NOTES:

TITLE:

SECTION DETAILS

SHEET:


**ST3.00**

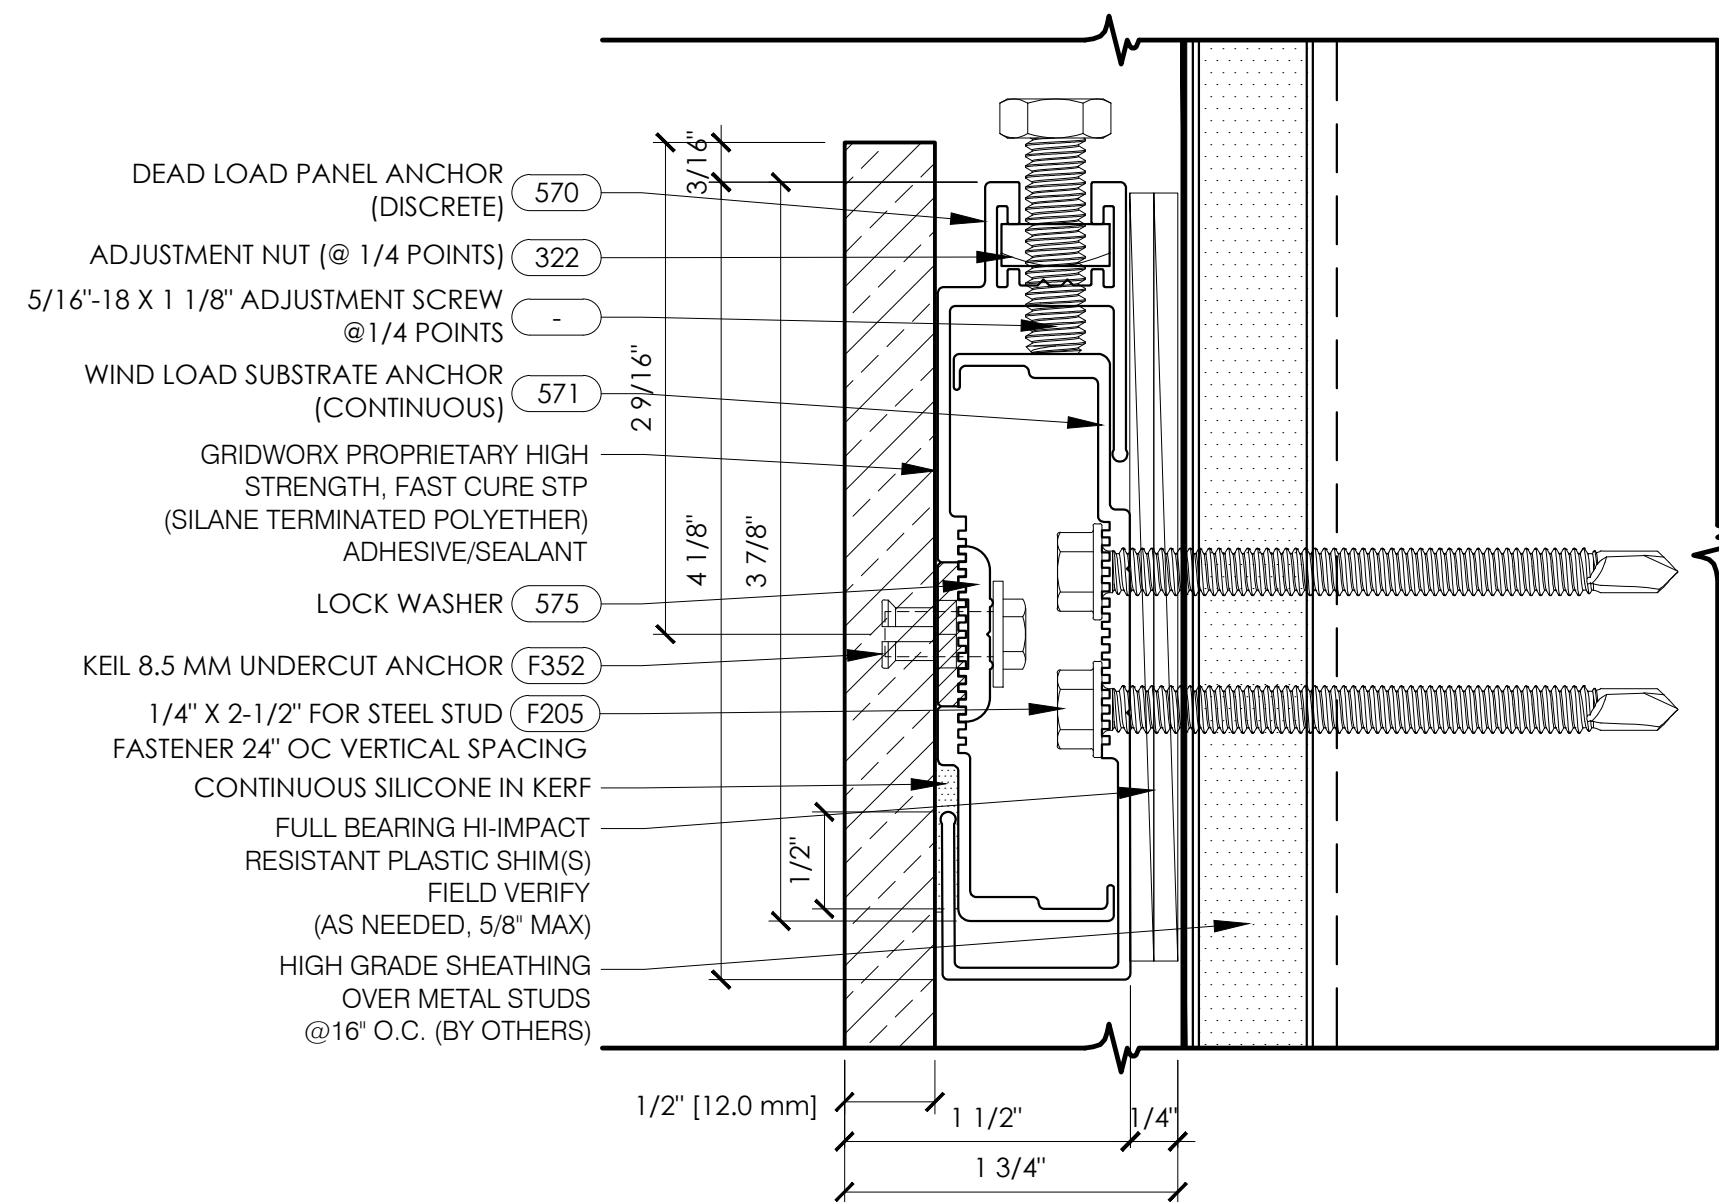

TOP ANCHOR  
WITH STEEL SUBSTRATE

01  
ST3.01


ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

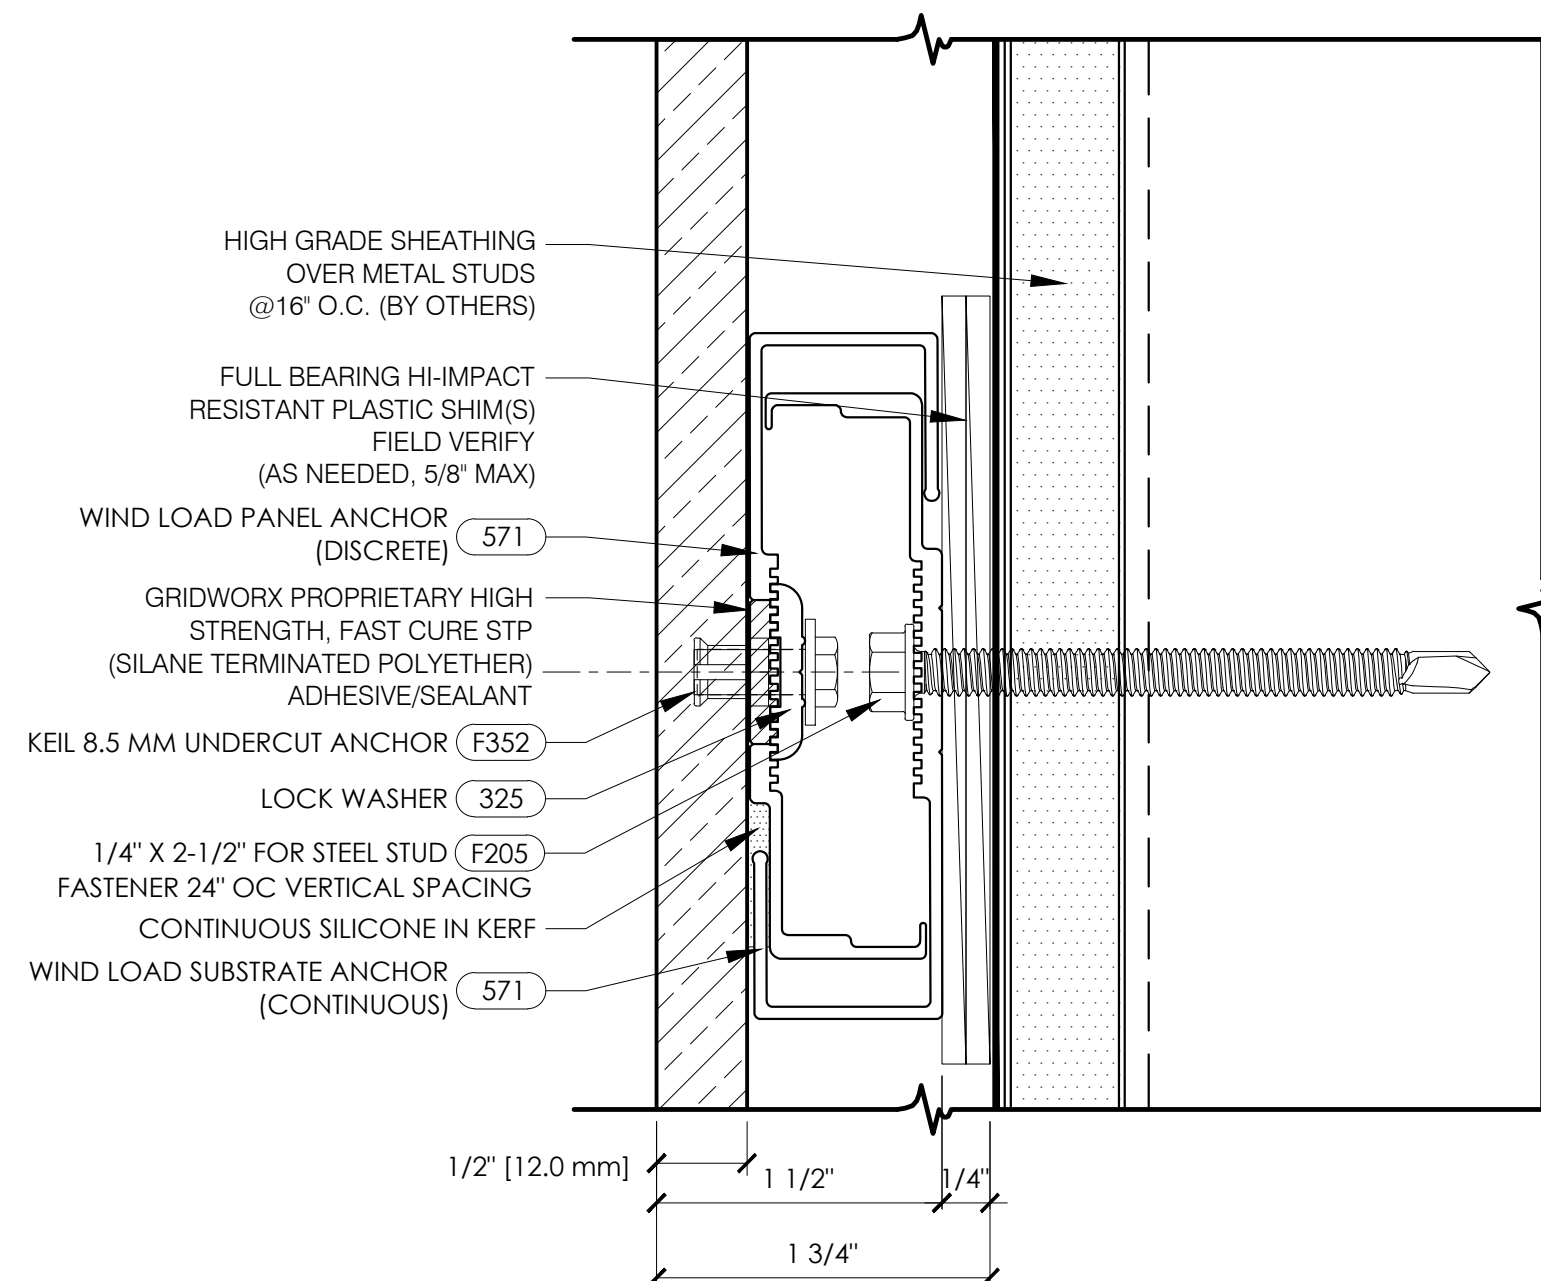

INTERMEDIATE SUPPORT  
WITH STEEL SUBSTRATE

03  
ST3.01


ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

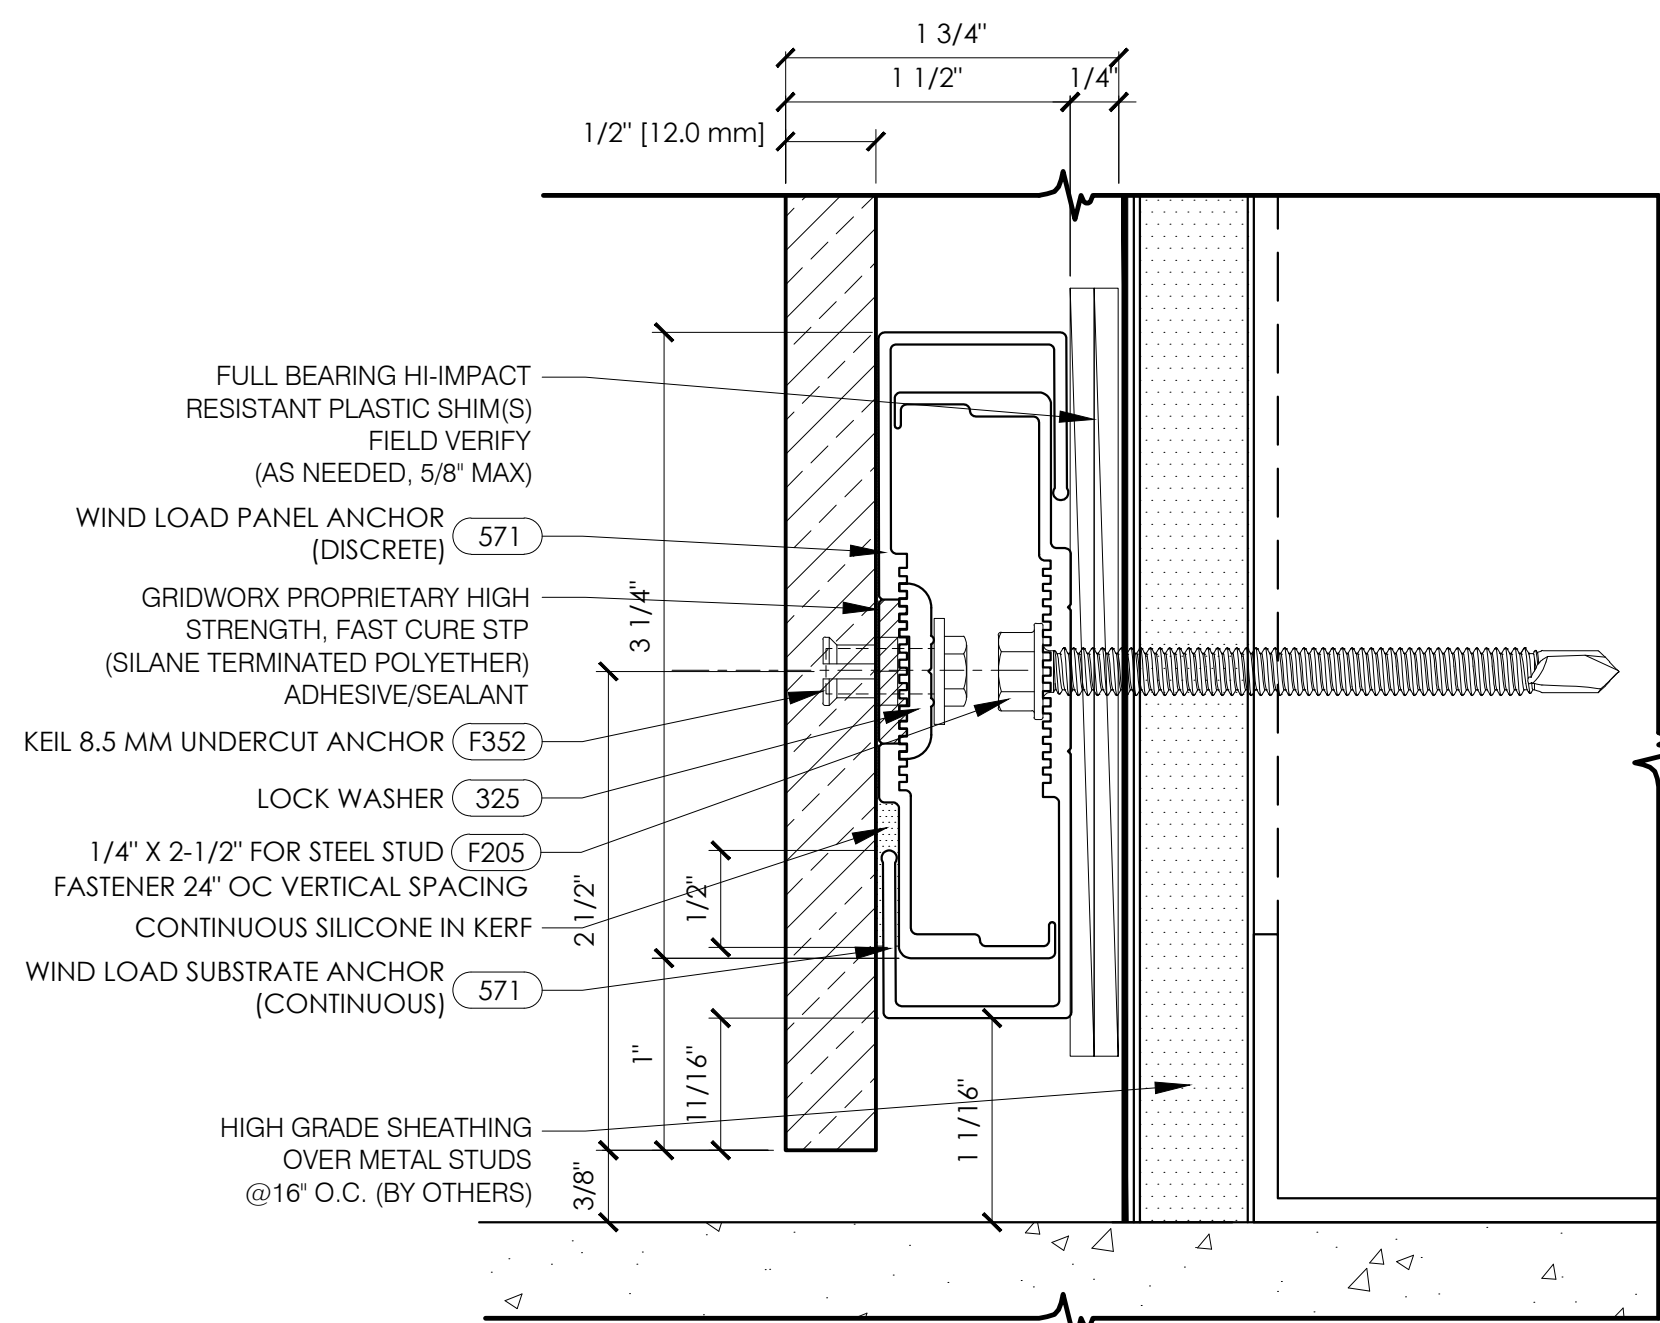

BOTTOM ANCHOR  
WITH STEEL SUBSTRATE

02  
ST3.01

ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

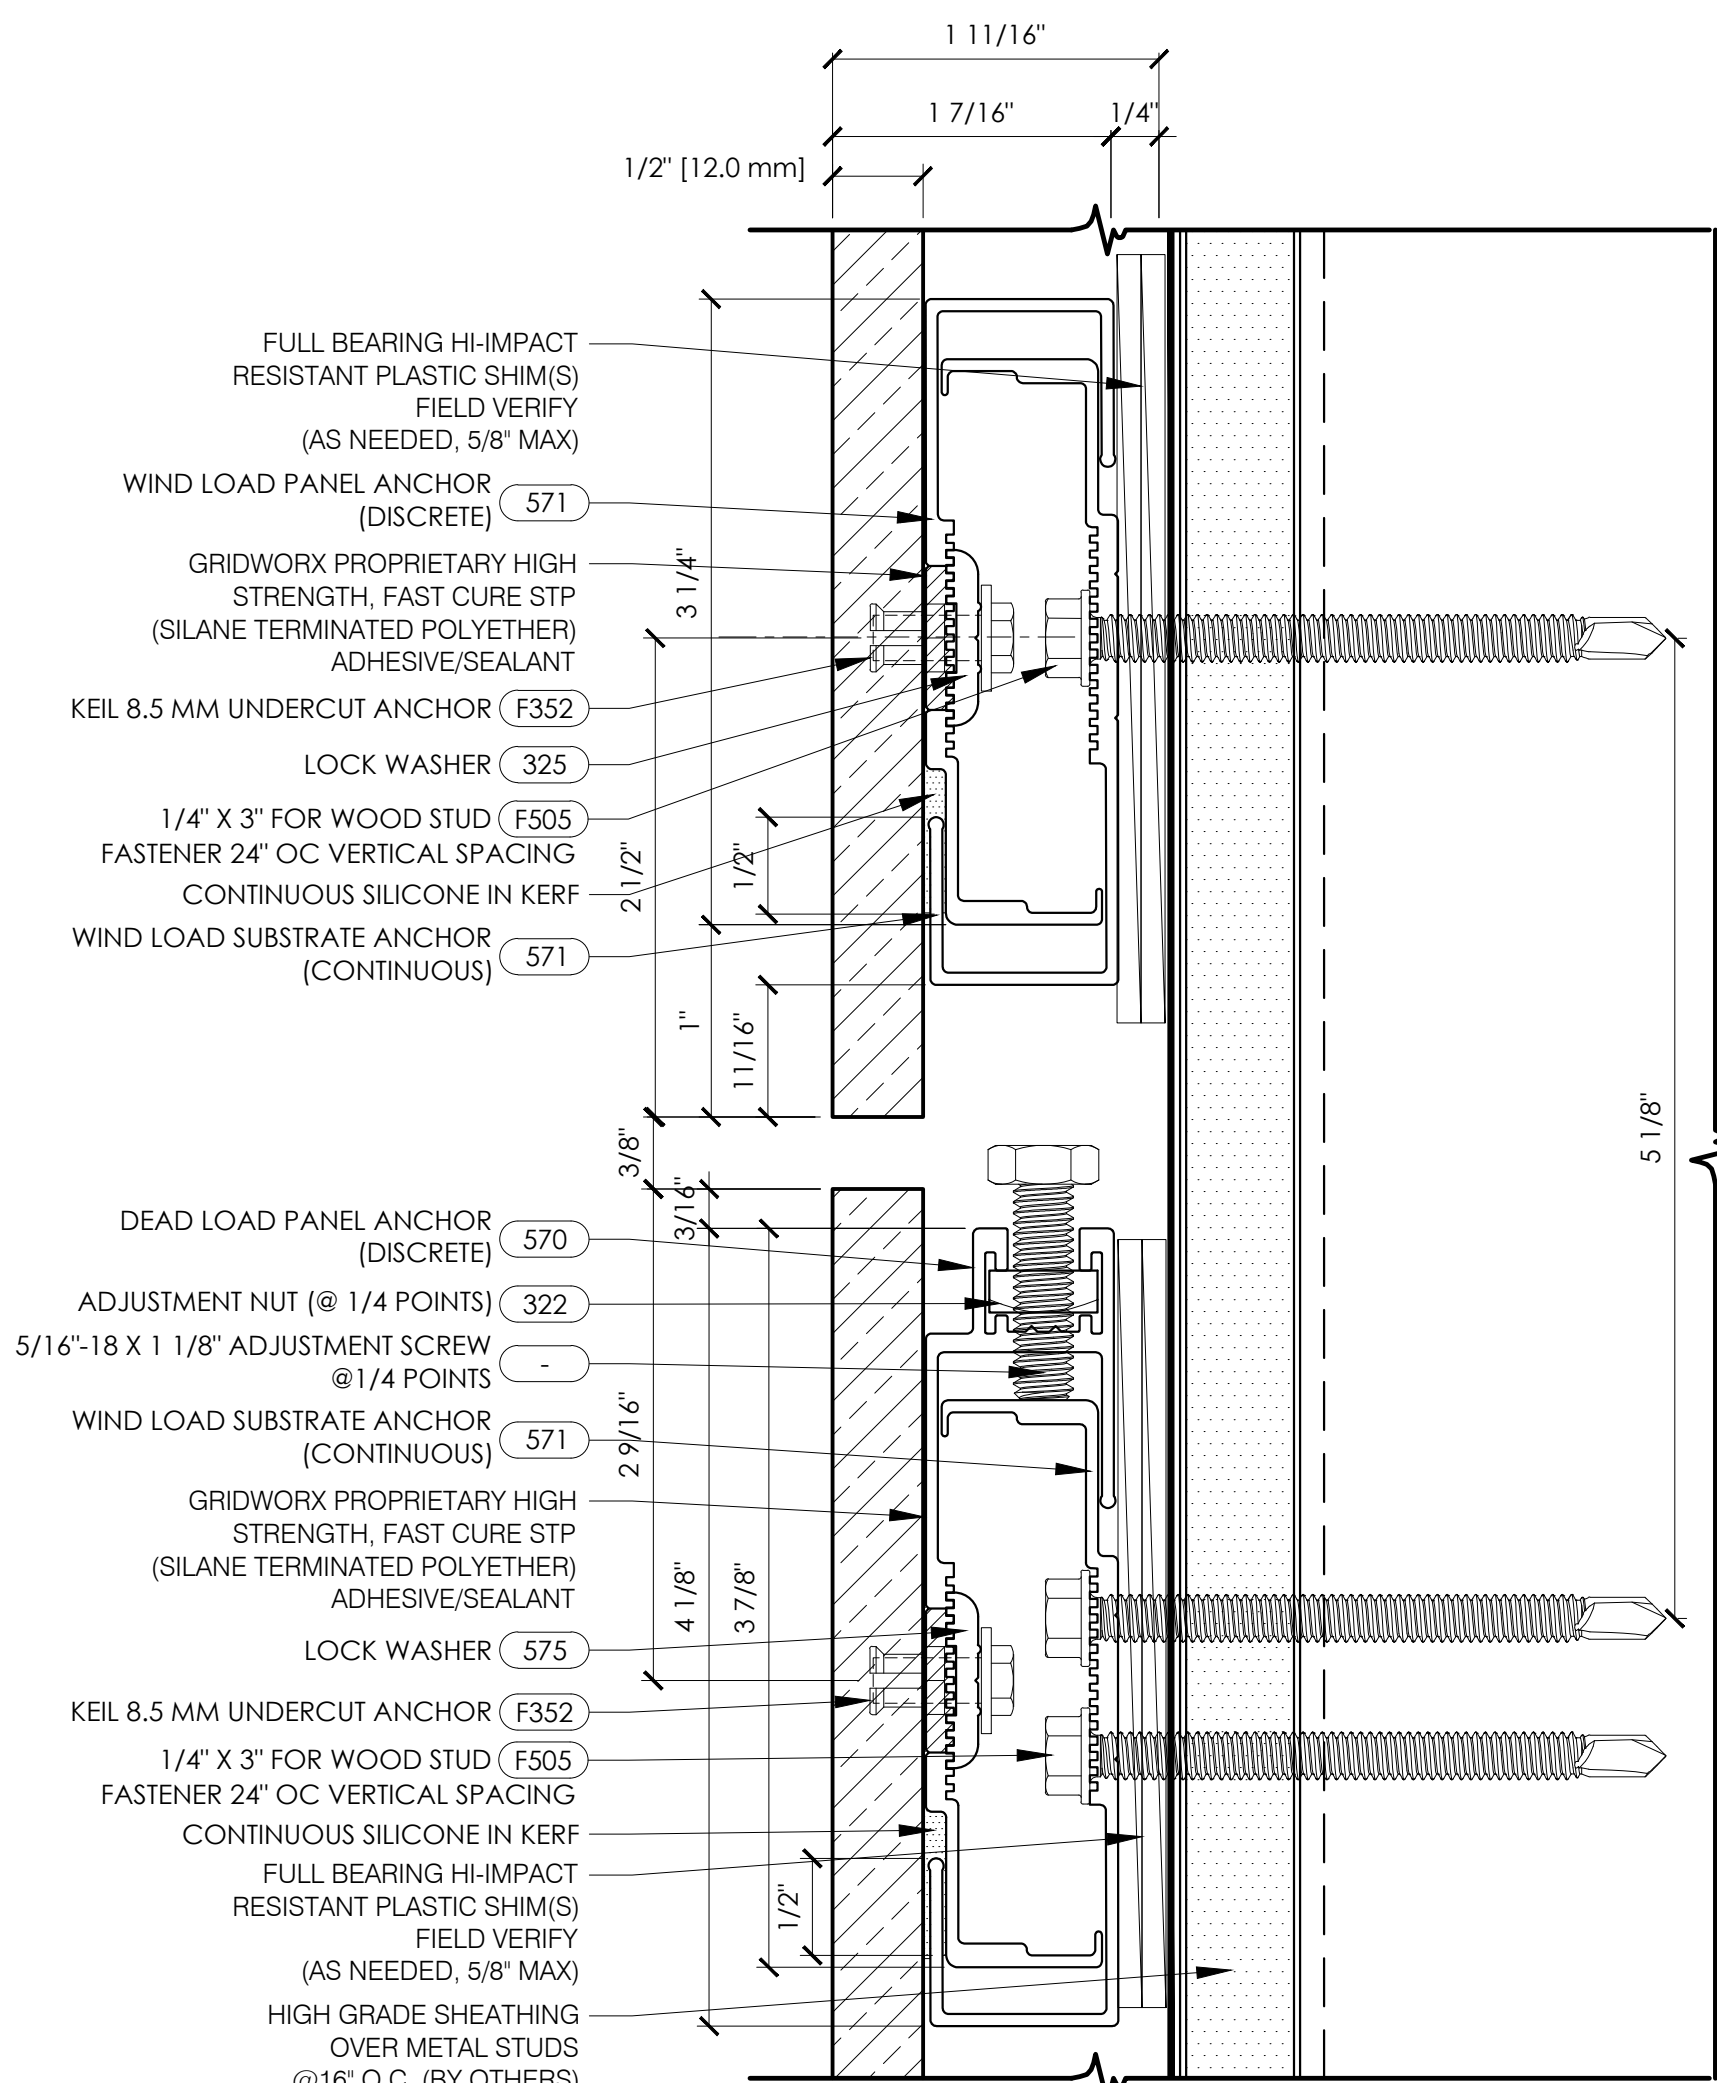

ANCHORS AT HORIZONTAL  
JOINT WITH STEEL SUBSTRATE

04  
ST3.01

ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

DRAWN BY:

**GRIDWORX**  
STONE HANGING SYSTEM

PRECISION WALL SYSTEMS  
10980 ALDER CIRCLE  
DALLAS, TEXAS 75238

TEL: 214.774.4502  
FAX: 214.432.5963

ARCHITECT:  
N/A

**PRECISION WALL SYSTEMS**  
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:


NOTES:

TITLE:

SECTION DETAILS


SHEET:

**ST3.01**

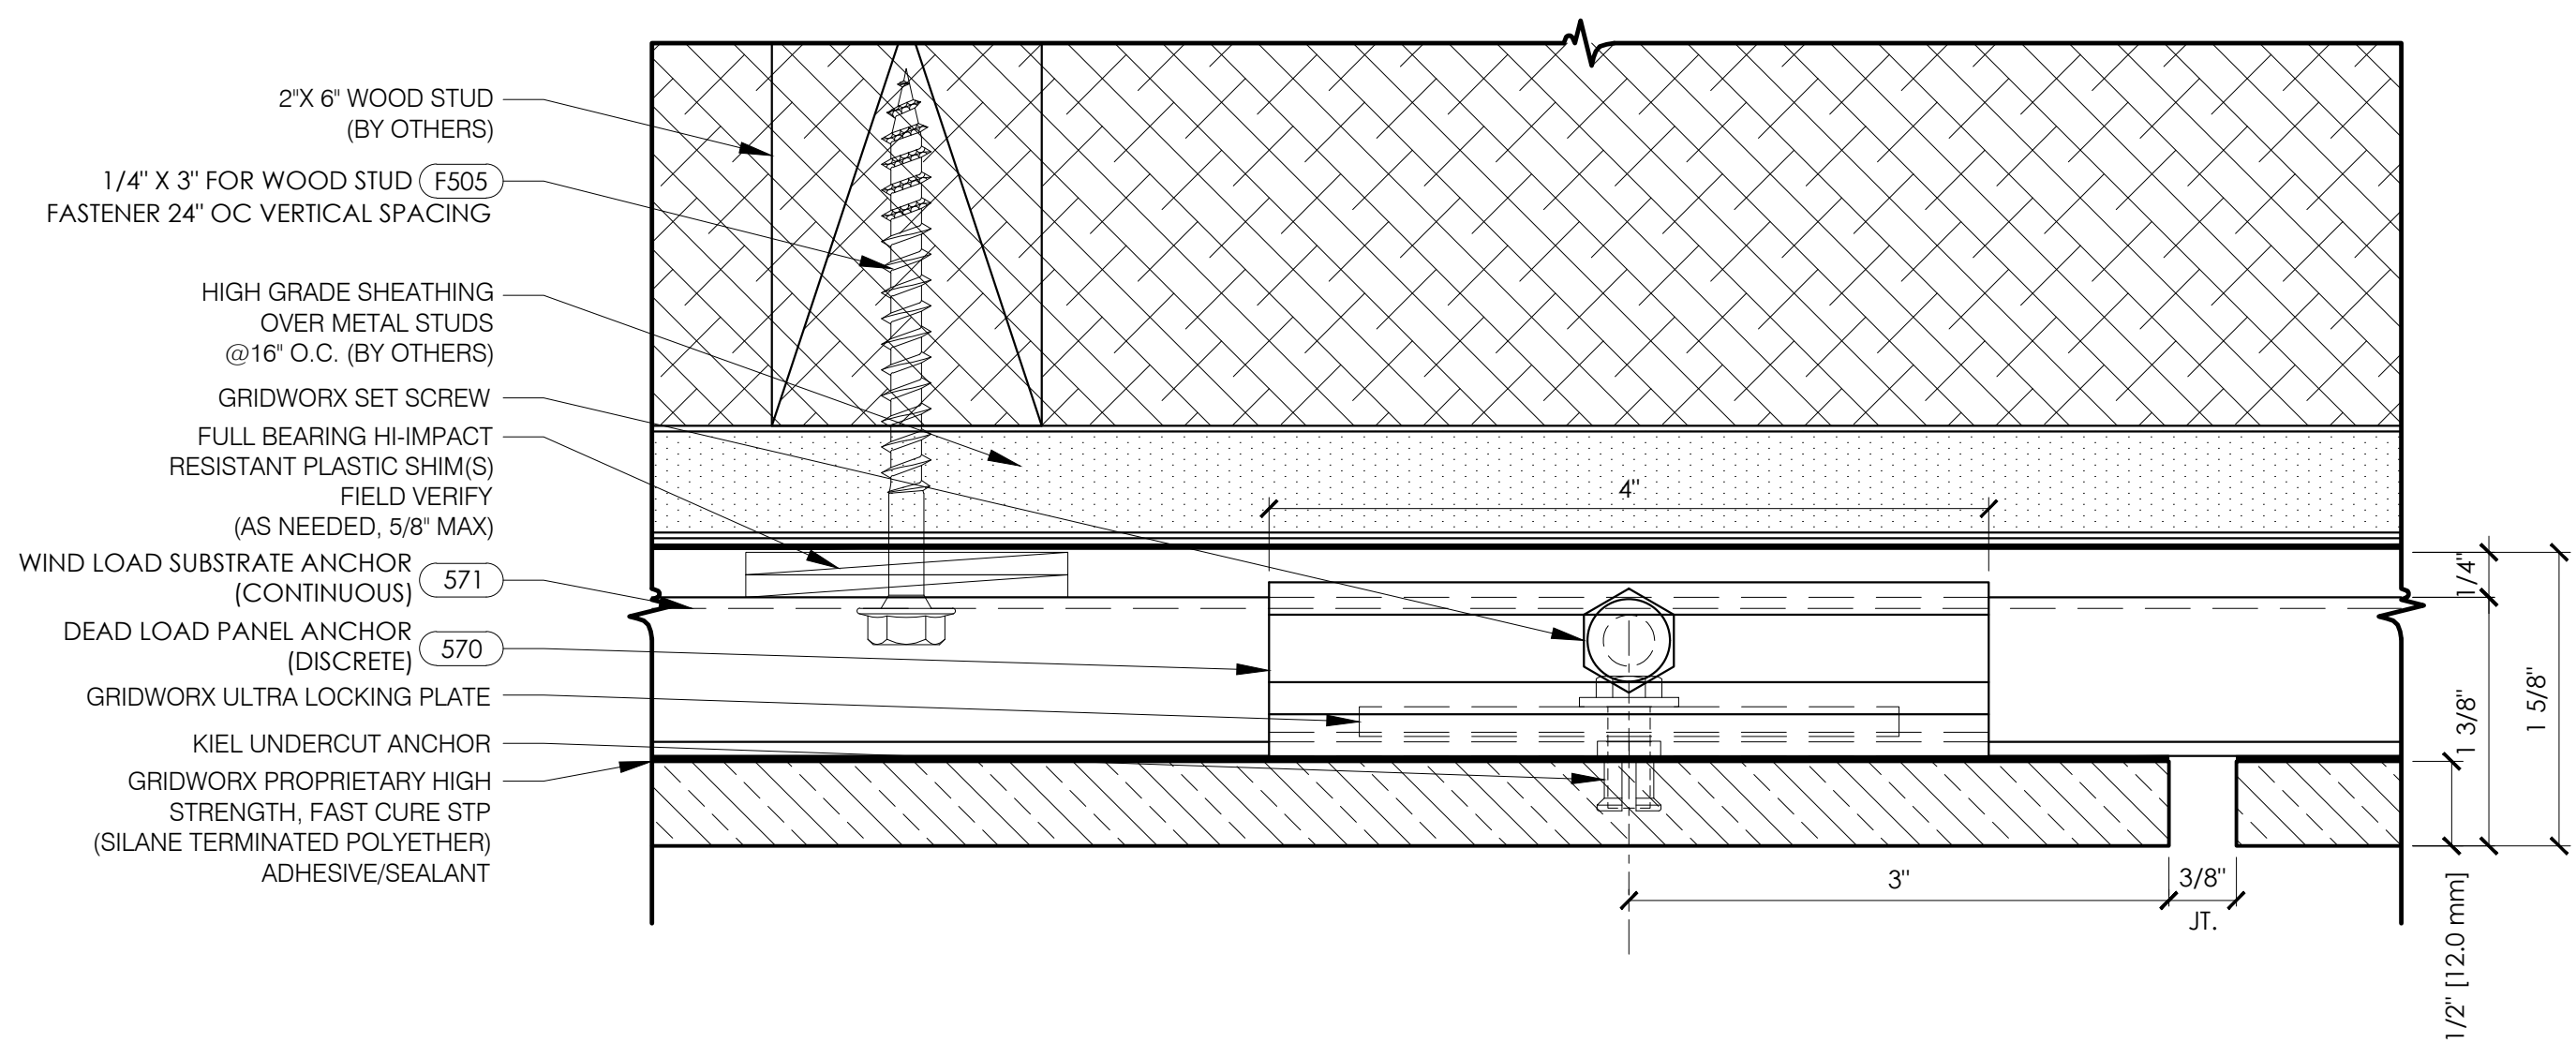

PLAN DETAIL AT STONE JOINT  
WITH WOOD SUBSTRATE

01  
ST4.00 ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

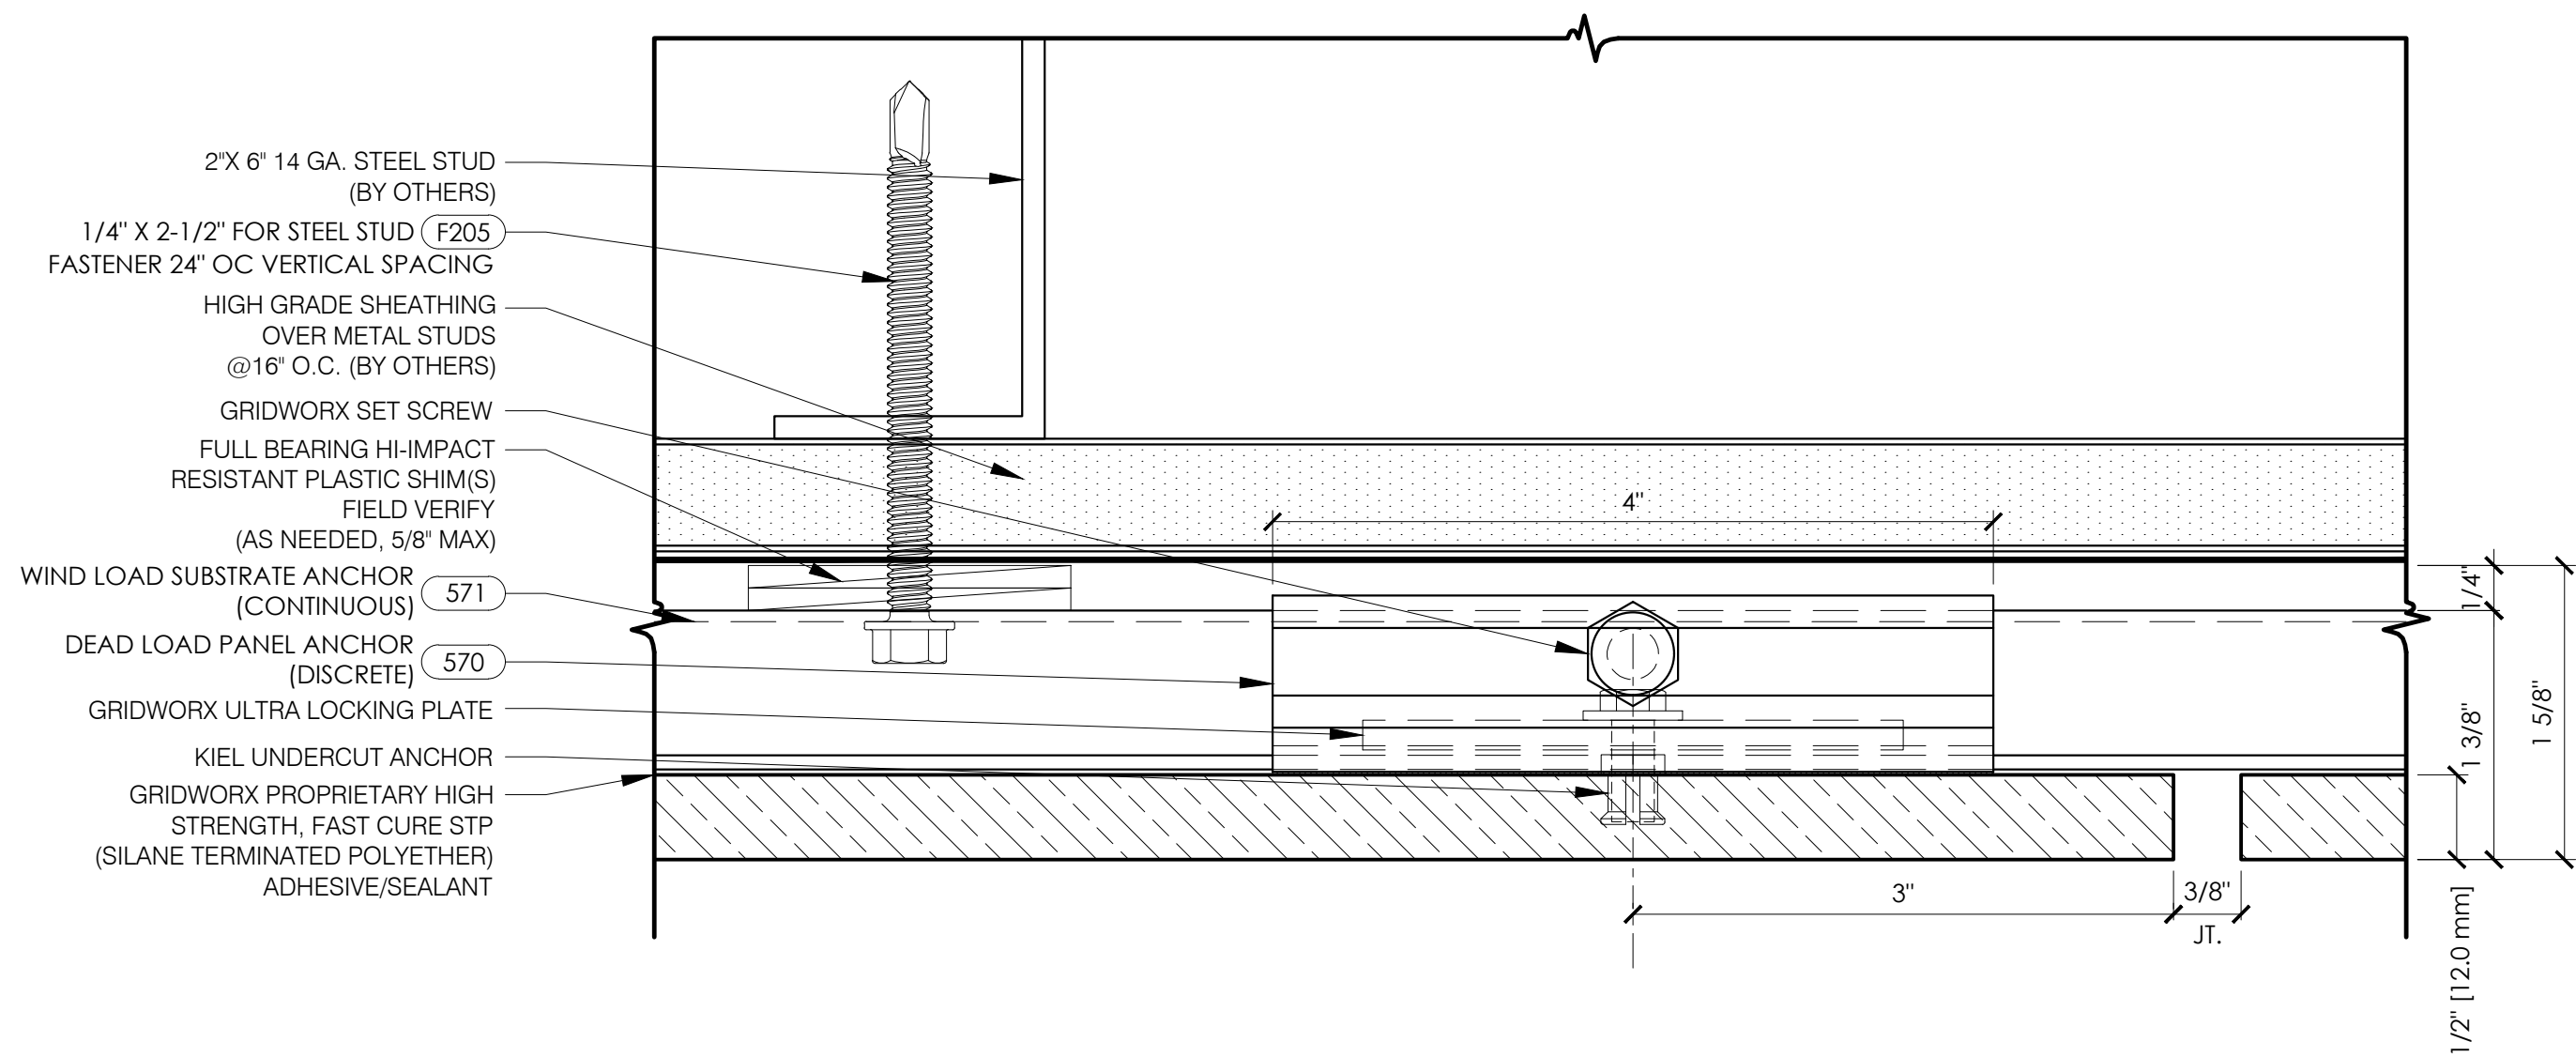

PLAN DETAIL AT STONE JOINT  
WITH STEEL SUBSTRATE

02  
ST4.00 ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

DRAWN BY:



PRECISION WALL SYSTEMS  
10980 ALDER CIRCLE  
DALLAS, TEXAS 75238

TEL: 214.774.4502  
FAX: 214.432.5963

ARCHITECT:  
N/A

PRECISION WALL SYSTEMS  
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:

SECTION DETAILS

SHEET:

ST4.00

DRAWN BY:



PRECISION WALL SYSTEMS  
10980 ALDER CIRCLE  
DALLAS, TEXAS 75238

TEL: 214.774.4502  
FAX: 214.432.5963

ARCHITECT:  
N/A

PRECISION WALL SYSTEMS  
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:



NOTES:


TITLE:

SECTION DETAILS


SHEET:

ST4.01

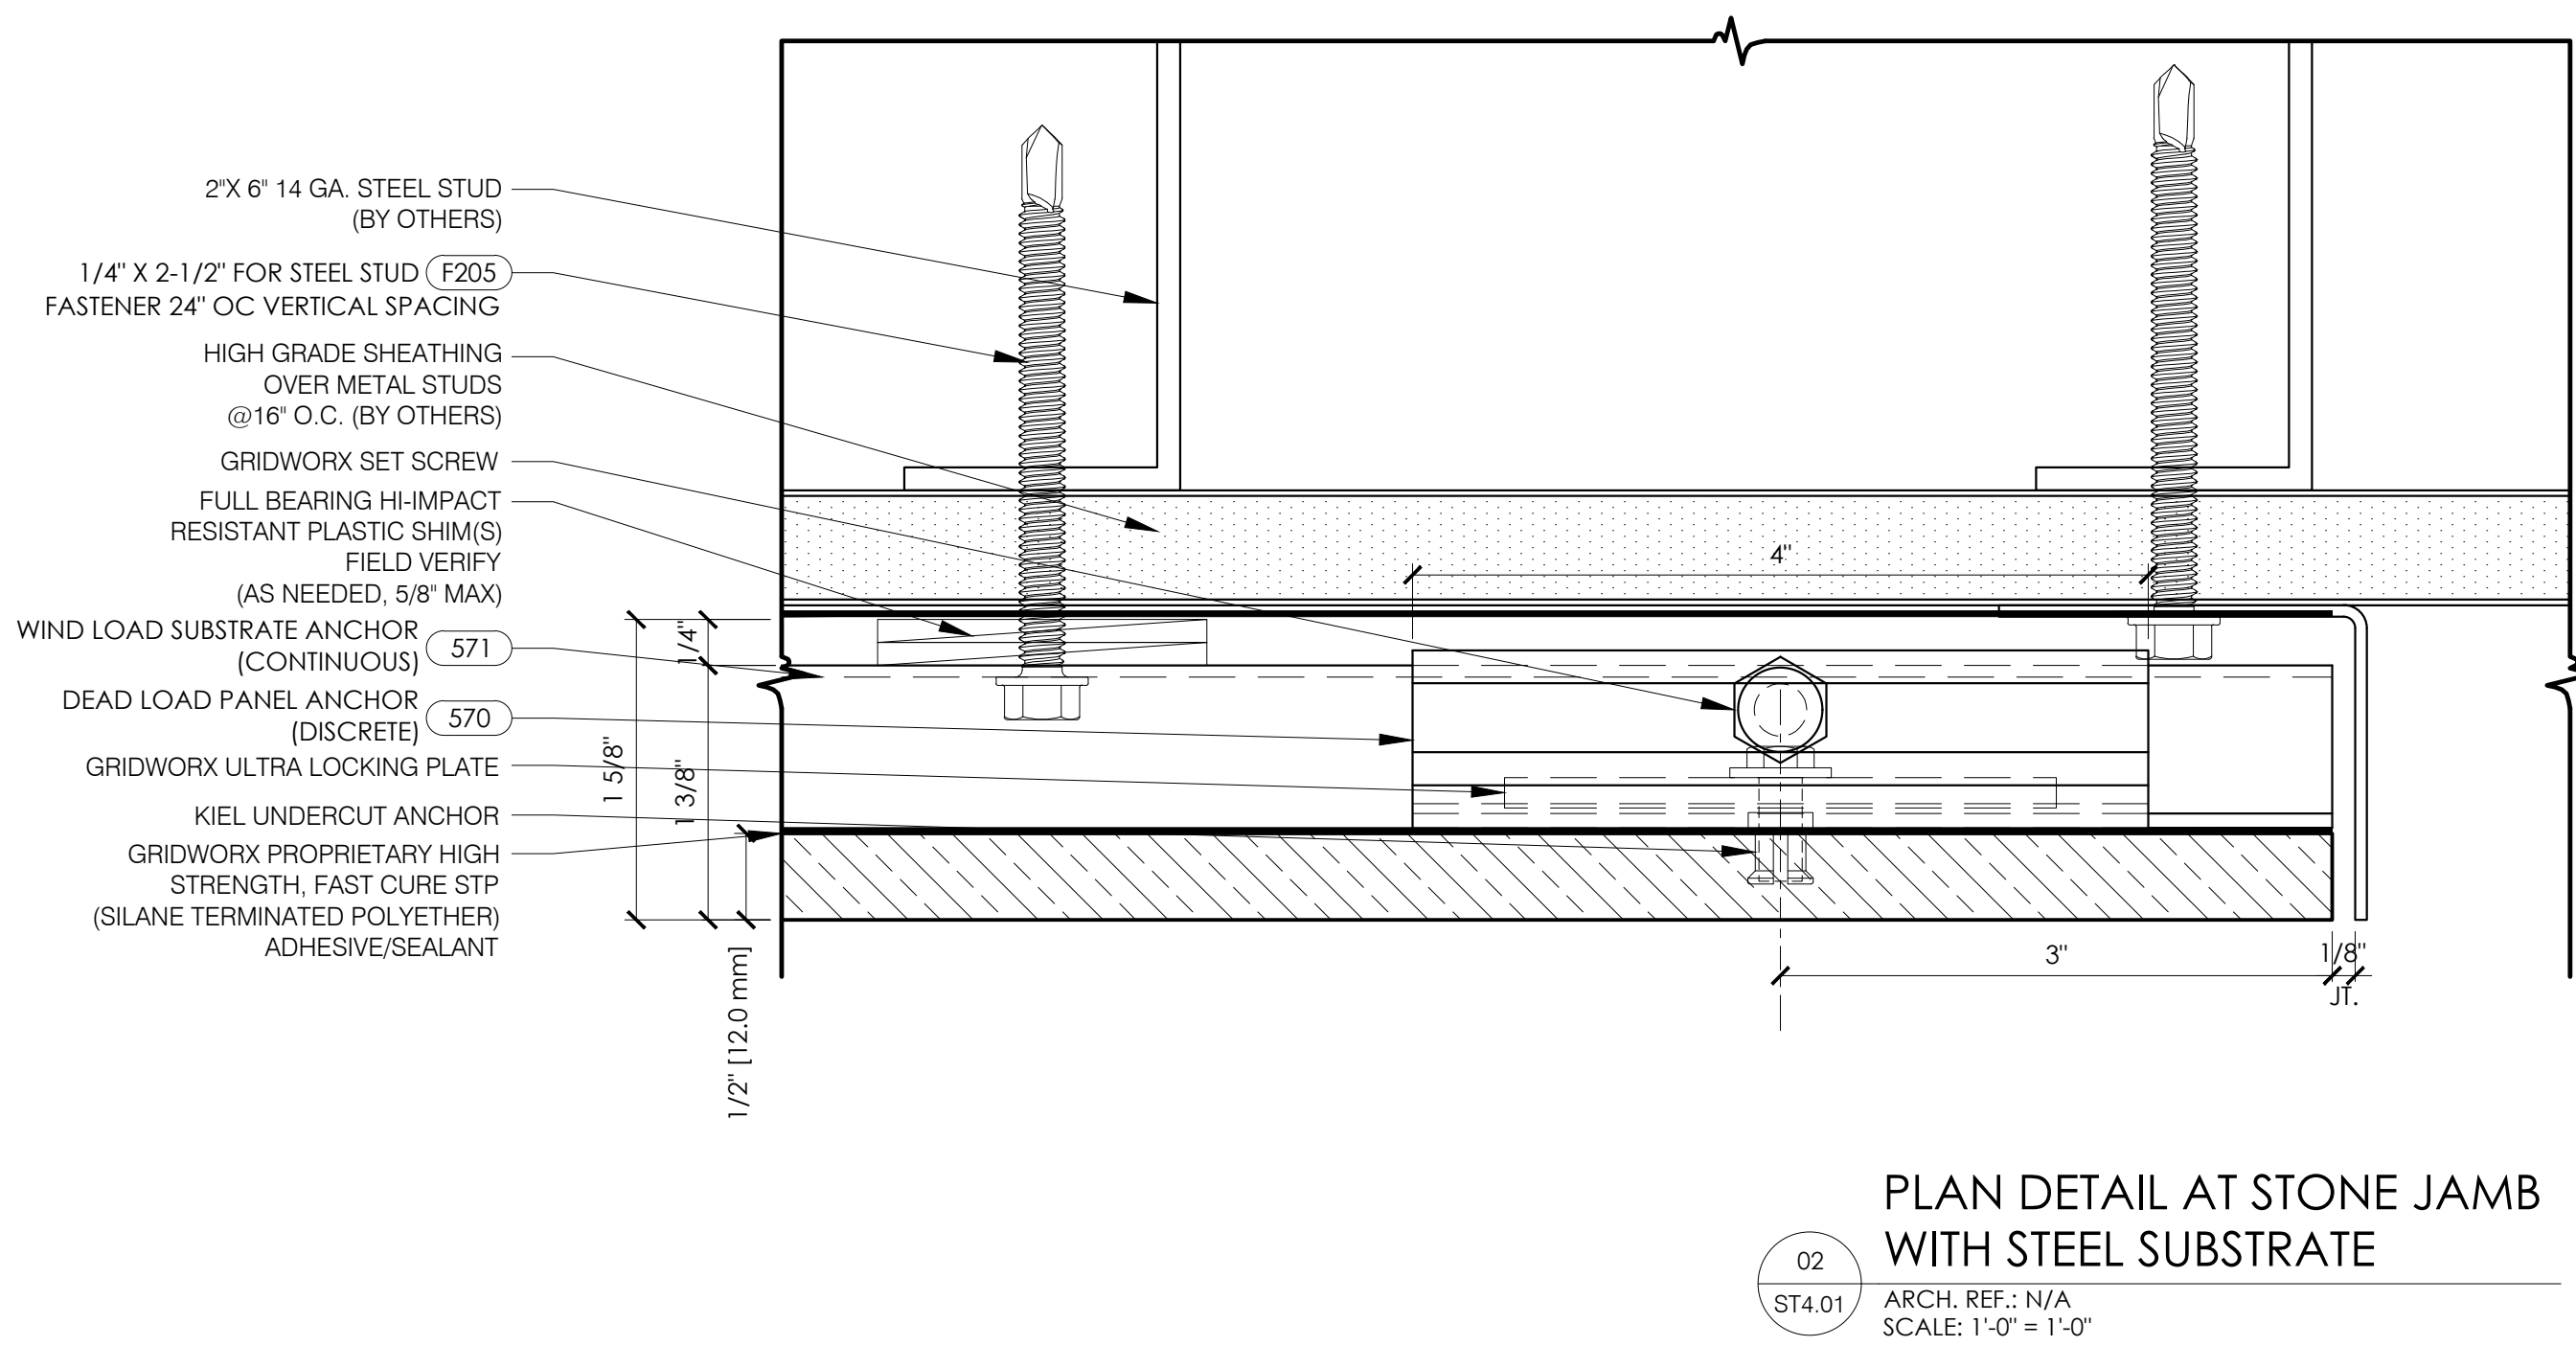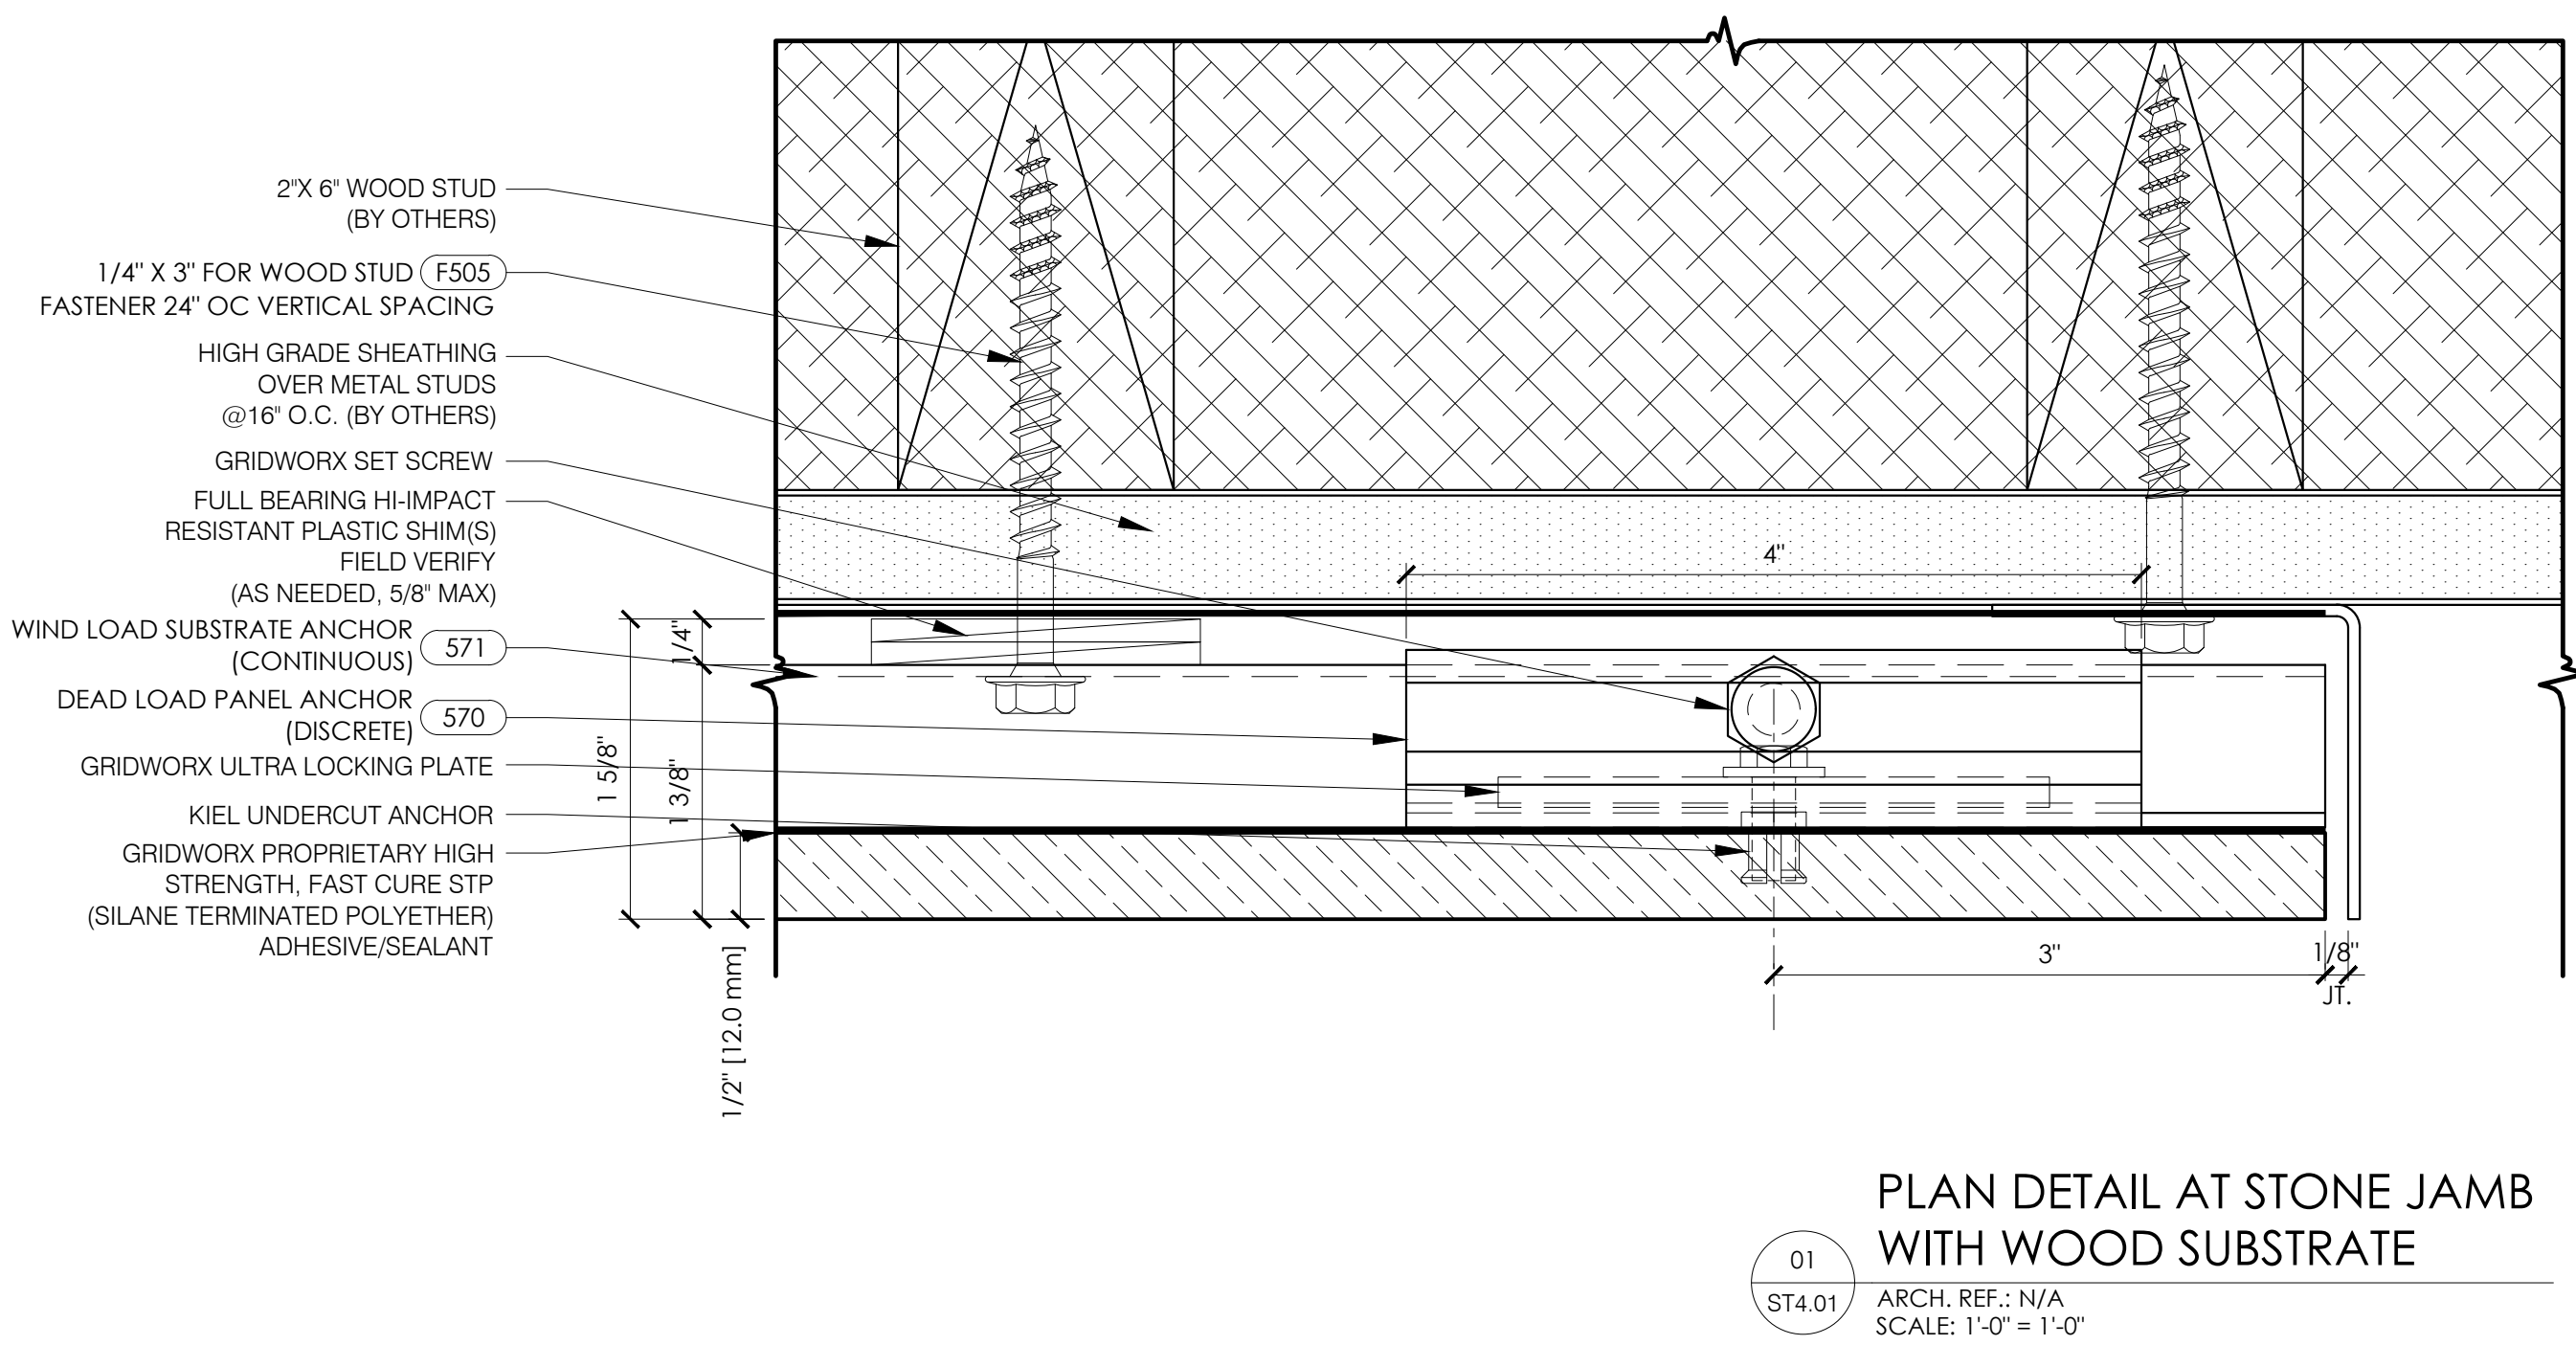

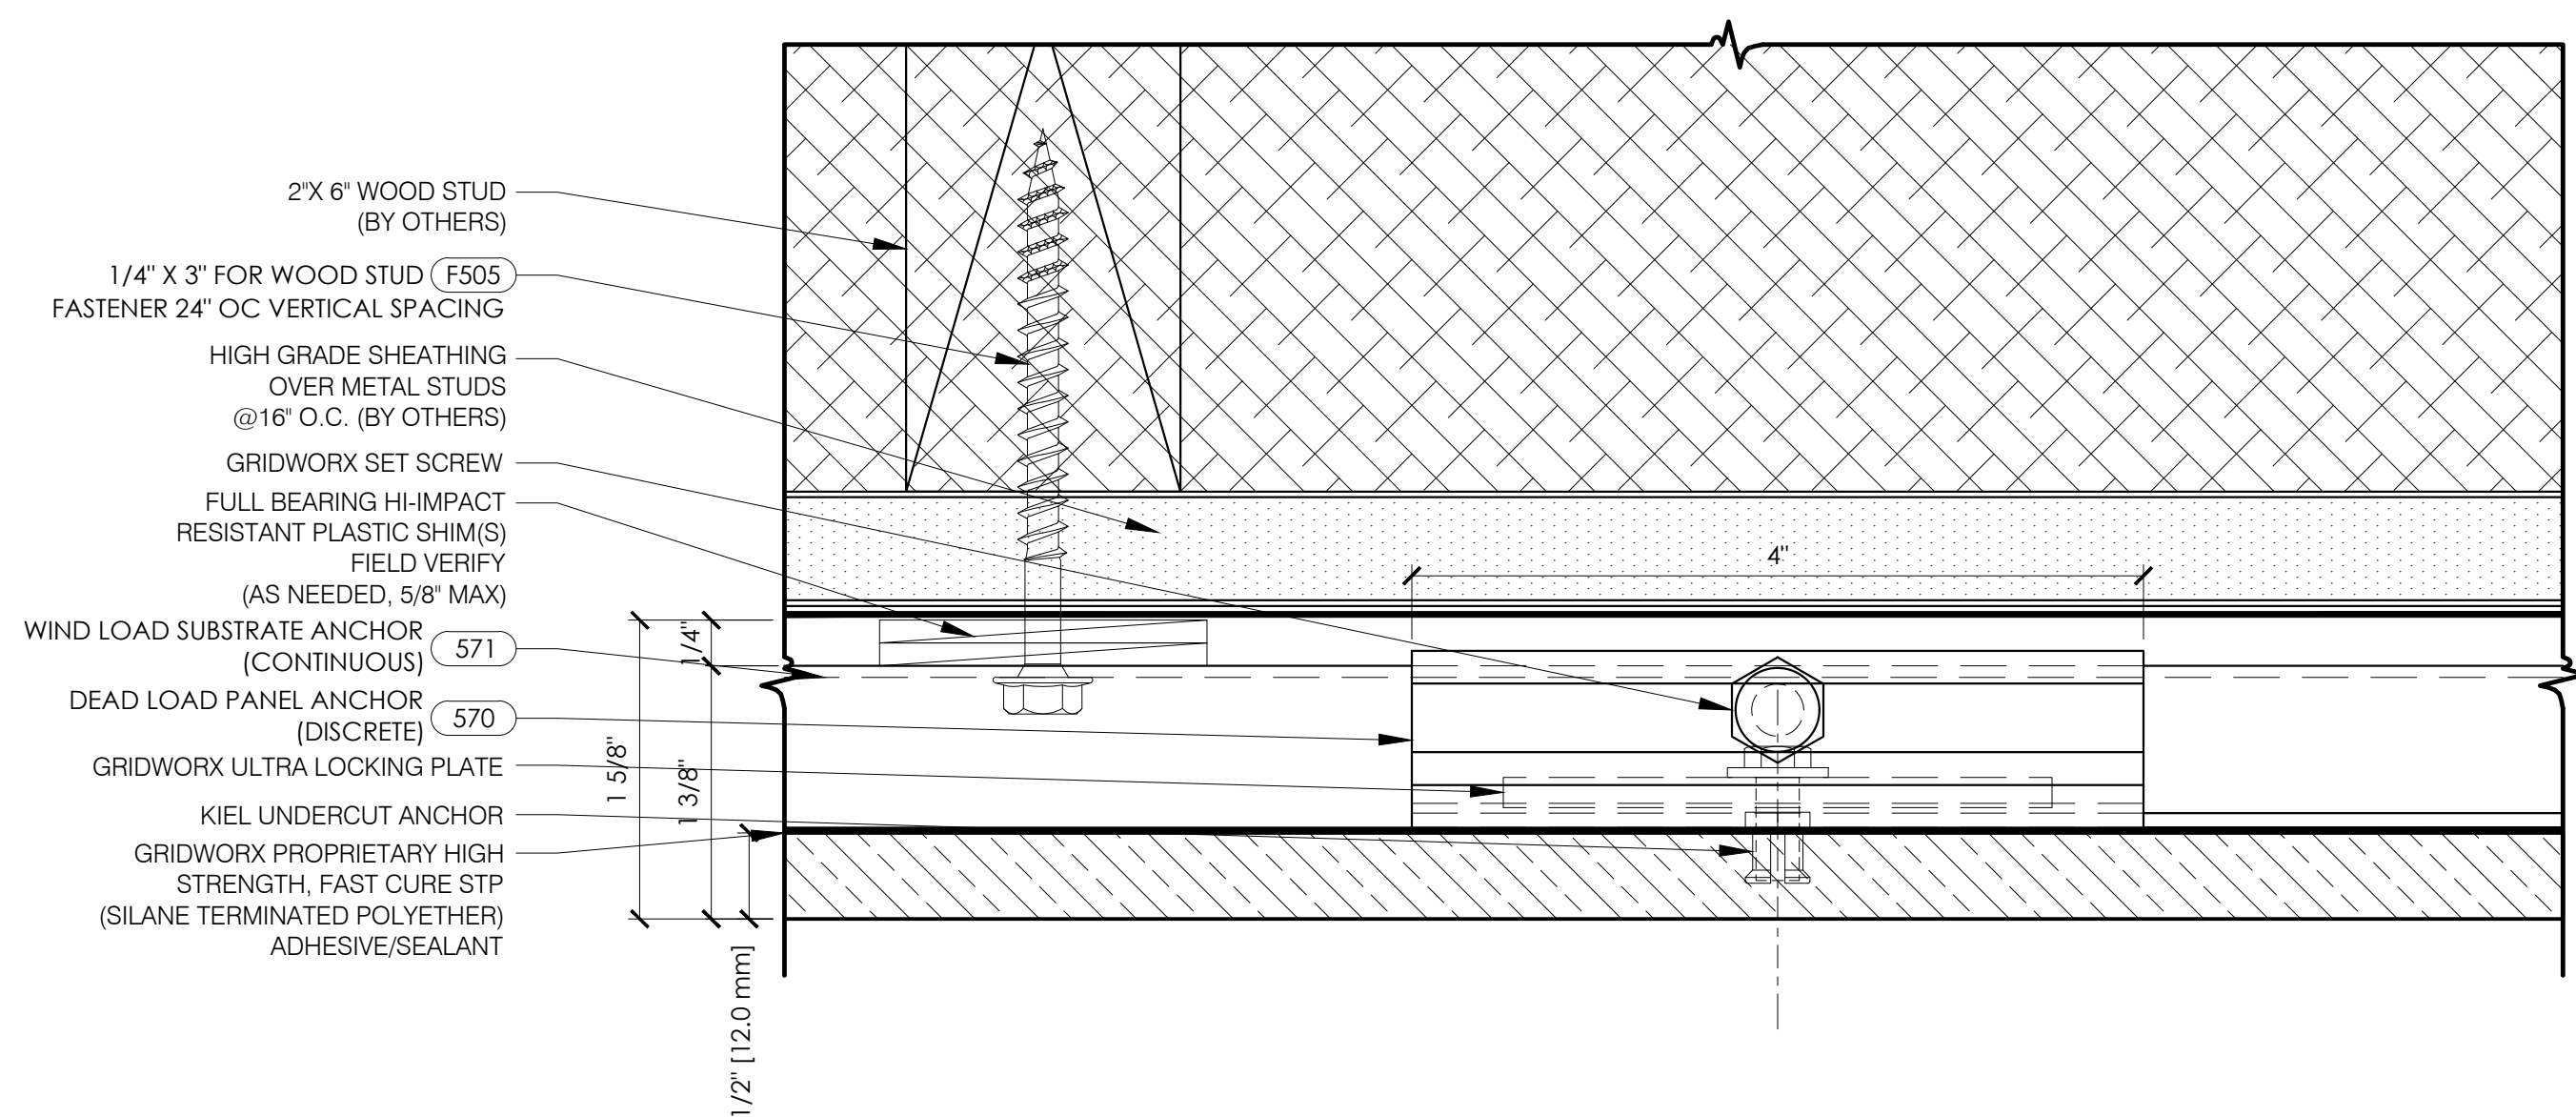

01  
ST4.02  
PLAN DETAIL AT INTERMEDIATE  
ANCHOR WITH WOOD SUBSTRATE  
ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

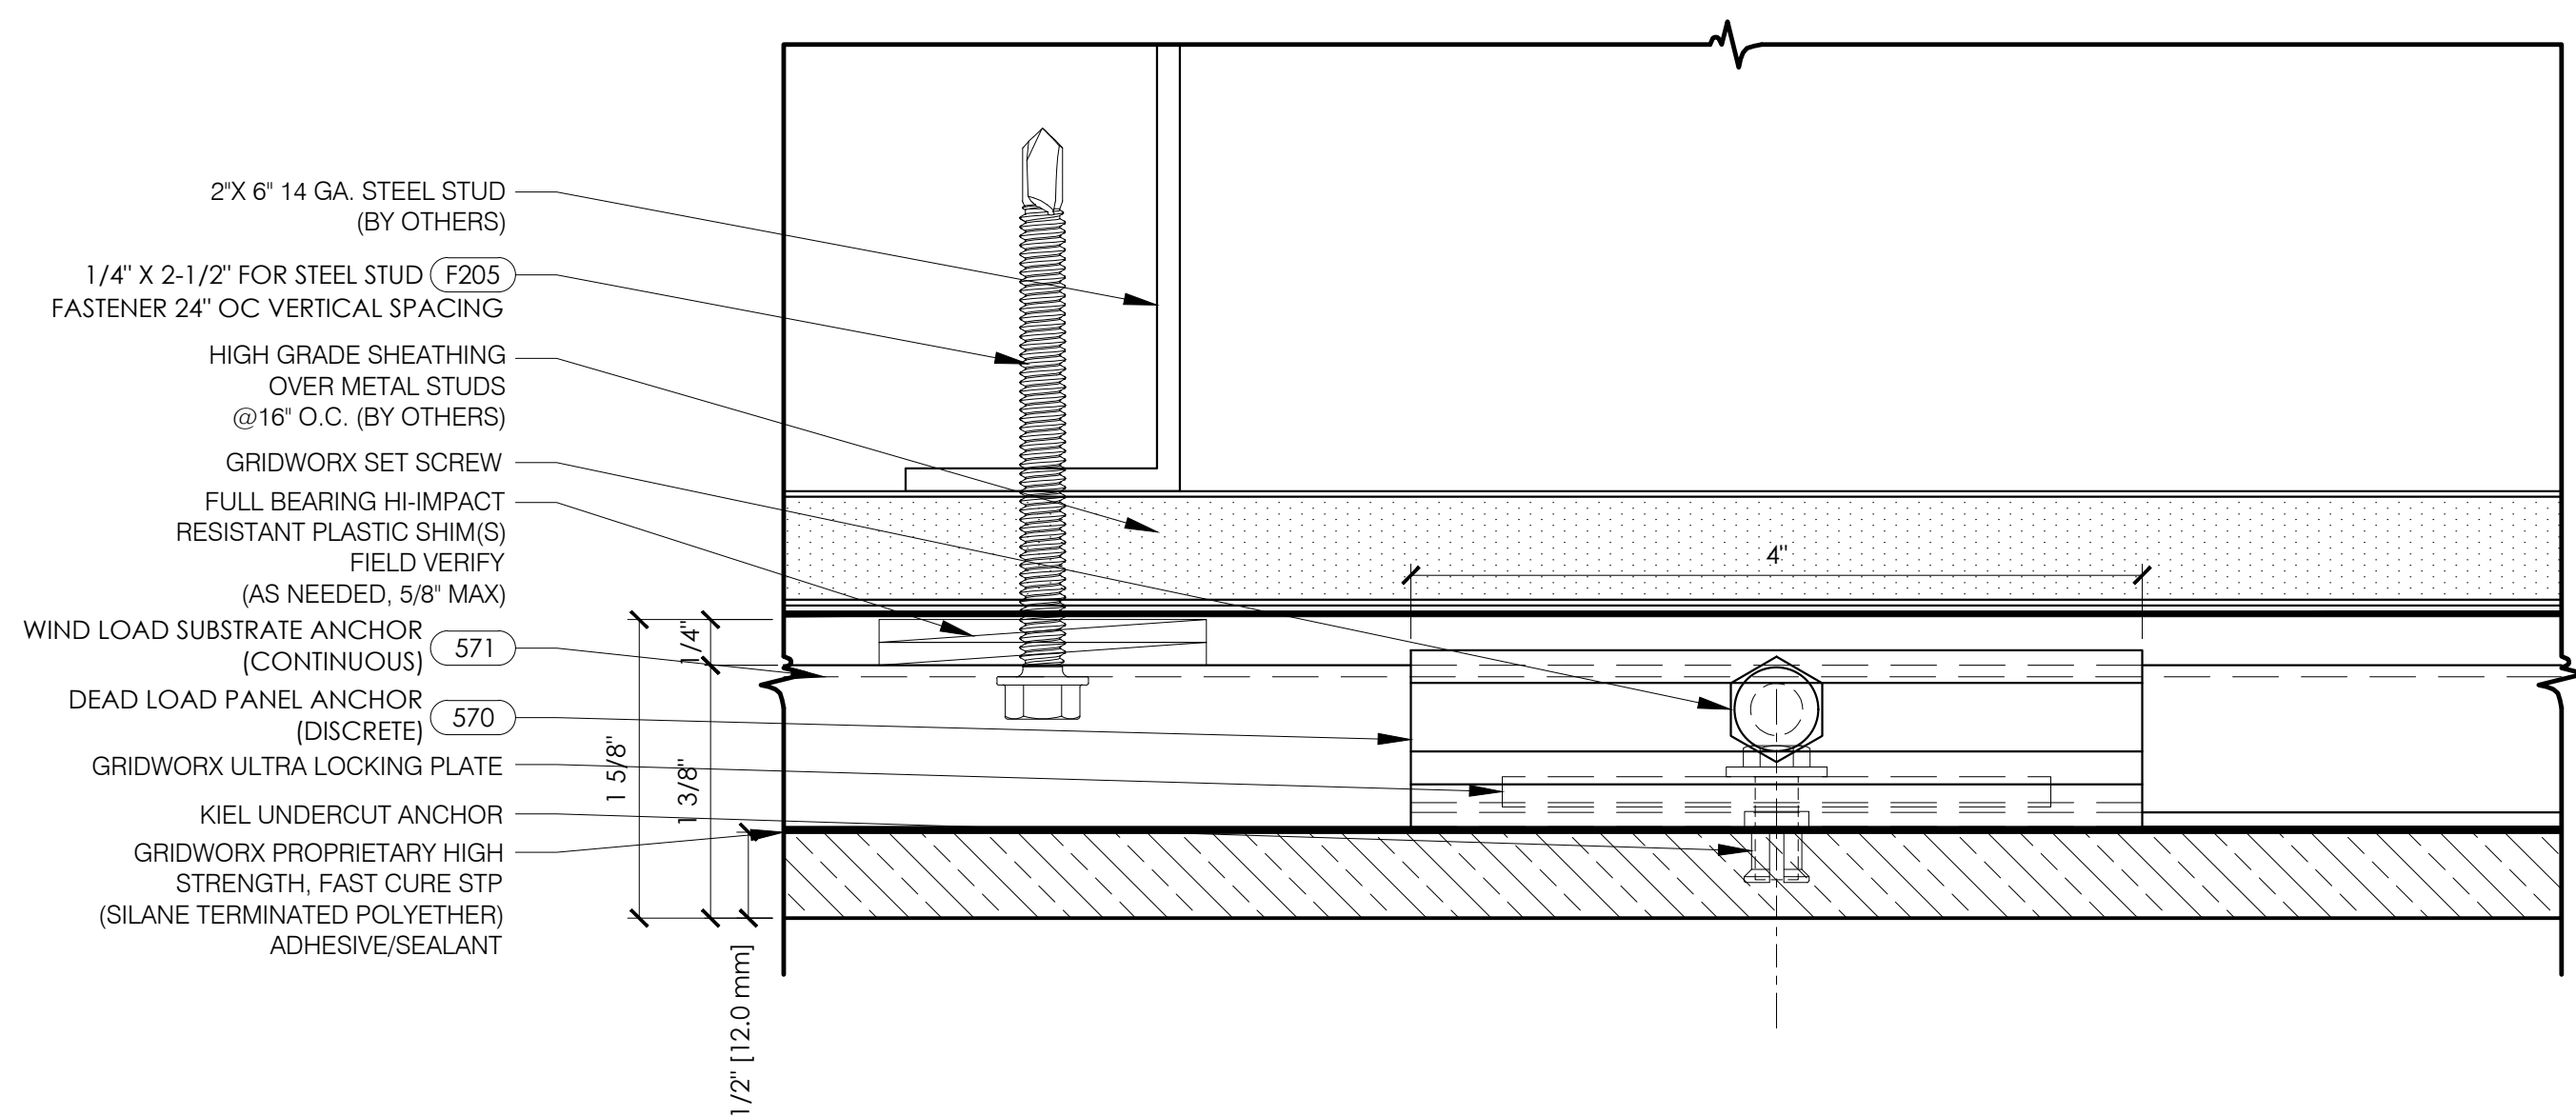

02  
ST4.02  
PLAN DETAIL AT STONE INTERMEDIATE  
ANCHOR WITH STEEL SUBSTRATE  
ARCH. REF.: N/A  
SCALE: 1'-0" = 1'-0"

DRAWN BY:



PRECISION WALL SYSTEMS  
10980 ALDER CIRCLE  
DALLAS, TEXAS 75238

TEL: 214.774.4502  
FAX: 214.432.5963

ARCHITECT:  
N/A

PRECISION WALL SYSTEMS  
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:

SECTION DETAILS

SHEET:

ST4.02