8148 NW 74 Avenue
Medley, FL, 33166
305.885.3328 ph. | 305.885.3329 fx

CLIENT: Cosentino
355 Alhambra Circle, 10th floor
Coral Gables, FL 33134

Project No: 21-1013	**Report Date:** April 13, 2021

SAMPLE ID: Series: 1.2 cm Dekton Ultra Compact Facade Systems

SAMPLE DESCRIPTION: 21'-0 3/8" (252 3/8") by 9'-3 3/8" (112 3/8") high; See page 4 for full description.

SAMPLING DETAIL: The test sample manufactured by Cosentino was submitted directly to FTL by the client. Samples were independently selected for testing.

DATE OF RECEIPT: Samples were received at the FTL Miami Laboratory on January 21, 2021.

TESTING PERIOD: January 27, 2021 to January 29, 2021.

TESTING LOCATION: Fenestration Testing Laboratory (FTL) – Miami, Florida, USA

AUTHORIZATION: Proposal 21AM01151, signed by Brendan Mercier, dated January 15, 2021.

TEST PROCEDURE: Testing to the following requirements:

- ASTM E330/E330M-14 Standard Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference

TEST RESULTS: The façade systems achieved passing results found within this test report when tested in accordance with the ASTM E330/E330M for research and development.

CONTENTS: Test report pages 1 through 9.

Prepared By

Lusinda Delgado

Lusinda Delgado
Technical Report Writer

Signed for and on behalf of
Fenestration Testing Laboratory

Jose Sanchez

Jose Sanchez
Operation Manager

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Table of Contents		Page	Rev
Revision Table		3	
Notes Table		3	
Sample A-1			
Description of Test Sample		4	
Additional Information		4	
Test Sample Installation		4	
Results Sample A-1			
Design Load Test Positive	ASTM E330	4	
Design Load Test Positive	ASTM E330	4	
Design Load Test Positive	ASTM E330	4	
Design Load Test Positive	ASTM E330	5	
Design Load Test Positive	ASTM E330	5	
Design Load Test Positive	ASTM E330	5	
Design Load Test Positive	ASTM E330	5	
Design Load Test Positive	ASTM E330	5	
Design Load Test Positive	ASTM E330	6	
Design Load Test Positive	ASTM E330	6	
Design Load Test Positive	ASTM E330	6	
Design Load Test Positive	ASTM E330	6	
Design Load Test Positive	ASTM E330	6	
Design Load Test Negative	ASTM E330	7	
Design Load Test Negative	ASTM E330	7	
Design Load Test Negative	ASTM E330	7	
Design Load Test Negative	ASTM E330	7	
Design Load Test Negative	ASTM E330	7	
Design Load Test Negative	ASTM E330	8	
Design Load Test Negative	ASTM E330	8	
Design Load Test Negative	ASTM E330	8	
Design Load Test Negative	ASTM E330	8	
Design Load Test Negative	ASTM E330	8	
Design Load Test Negative	ASTM E330	9	
Design Load Test Negative	ASTM E330	9	
Appendix A		9	
Appendix B		9	

Technician:
Yoenis Gonzalez

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Revision	Description	Effective Date
0	Initial Release	4/13/2021

Notes
* designates measurements by laboratory ** as per manufacturer Fenestration Testing Laboratory Inc., does not have, nor does it intend to acquire or will acquire, a financial interest in any company manufacturing or distributing products tested or labeled by the Fenestration Testing Laboratory Inc. Fenestration Testing Laboratory Inc., is not owned, operated or controlled by any company manufacturing or distributing products it tests or labels. Test loads were held for 10 seconds. At conclusion of testing there was no visible damage to stone wall or fasteners withdrawal from the assembly. Test specimens were covered with 1.5 mil plastic sheeting to seal from air leakage when load test were performed, however this had no effect on below results.

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

DESCRIPTION OF SAMPLE	
Model Designation:	Series: 1.2 cm Dekton Ultra Compact Facade Systems
Overall Size:	21'-0 3/8" (252 3/8") by 9'-3 3/8" (112 3/8") high
Number of Panels:	Four
Size of Panels:	10'-6" (126") by 4'-8" (56") high
Sample A-1	

Additional Information
The sample was tested using one 5/16-18 by 3/4" set screw located on the Gridwork Ultra dead load anchor, first row of each panel. The screws were located at 1/4" points of the panel.

Sample Installation
The panels were installed onto a 14-gauge steel studded wall that has a 5/8" Densglass board. One Gridwork Ultra wind load anchor located horizontally, spaced 26" on center and fastened to the wall using a single row of No. 14 by 3" HWH SDS plastic shim spaced 16" on center. The panels engage onto the Gridwork Ultra deadload anchor. The Gridwork Ultra anchor was located horizontally behind each panel and was fastened using a single row of **Keli 555020830 undercut fastener with locking plate and spaced 2 1/16", 26 1/16", 74 1/8", 98 1/8" and 122" from left of each panel.

Sample: A-1	**Temperature:**	75.9°F	**Barometric Reading:** 30.0 inches Hg	
Title of Test		**Pressure**	**Notes**	
Design Load Test Positive Load		15.0 psf		
see appendix A				
Reading#	**Deflection**	**Permanent Set**	**Results**	**Add. Info**
1	0.065"	0.017"	Passed	
2	0.116"	0.016"	Passed	
3	0.122"	0.012"	Passed	

Sample: A-1	**Temperature:**	75.9°F	**Barometric Reading:** 30.0 inches Hg	
Title of Test		**Pressure**	**Notes**	
Design Load Test Positive Load		30.0 psf		
see appendix A				
Reading#	**Deflection**	**Permanent Set**	**Results**	**Add. Info**
1	0.166"	0.034"	Passed	
2	0.239"	0.022"	Passed	
3	0.259"	0.031"	Passed	

Sample: A-1	**Temperature:**	75.9°F	**Barometric Reading:** 30.0 inches Hg	
Title of Test		**Pressure**	**Notes**	
Design Load Test Positive Load		45.0 psf		
see appendix A				
Reading#	**Deflection**	**Permanent Set**	**Results**	**Add. Info**
1	0.272"	0.054"	Passed	
2	0.343"	0.034"	Passed	
3	0.369"	0.055"	Passed	

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		60.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.280"	0.063"	Passed	
2	0.368"	0.038"	Passed	
3	0.373"	0.072"	Passed	

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		75.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.273"	0.072"	Passed	
2	0.413"	0.050"	Passed	
3	0.430"	0.081"	Passed	

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		90.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.318"	0.081"	Passed	
2	0.431"	0.059"	Passed	
3	0.469"	0.090"	Passed	

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		105.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.376"	0.089"	Passed	
2	0.501"	0.066"	Passed	
3	0.530"	0.098"	Passed	

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		120.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.433"	0.102"	Passed	
2	0.557"	0.079"	Passed	
3	0.570"	0.110"	Passed	

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		135.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.476"	0.122"	Passed	
2	0.596"	0.094"	Passed	
3	0.598"	0.131"	Passed	

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		150.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.456"	0.148"	Passed	
2	0.617"	0.109"	Passed	
3	0.619"	0.152"	Passed	

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		180.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.475"	0.154"	Passed	
2	0.637"	0.116"	Passed	
3	0.642"	0.161"	Passed	

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		210.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.481"	0.159"	Passed	
2	0.650"	0.124"	Passed	
3	0.662"	0.170"	Passed	

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Positive Load		240.0 psf		
see appendix A				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.547"	0.168"	Passed	
2	0.748"	0.132"	Passed	
3	0.762"	0.183"	Passed	

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Sample: A-1	Temperature:	75.7°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		15.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.123"	0.027"	Passed	
2	0.137"	0.007"	Passed	
3	0.066"	0.002"	Passed	

Sample: A-1	Temperature:	75.7°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		30.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.241"	0.036"	Passed	
2	0.252"	0.019"	Passed	
3	0.173"	0.009"	Passed	

Sample: A-1	Temperature:	75.7°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		45.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.349"	0.052"	Passed	
2	0.513"	0.031"	Passed	
3	0.305"	0.042"	Passed	

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		60.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.429"	0.061"	Passed	
2	0.604"	0.052"	Passed	
3	0.406"	0.059"	Passed	

Sample: A-1	Temperature:	75.9°F	Barometric Reading: 30.0 inches Hg	
Title of Test		Pressure	Notes	
Design Load Test Negative Load		75.0 psf		
see appendix B				
Reading#	Deflection	Permanent Set	Results	Add. Info
1	0.522"	0.083"	Passed	
2	0.617"	0.071"	Passed	
3	0.524"	0.080"	Passed	

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Sample: A-1	**Temperature:**	75.9°F	**Barometric Reading:** 30.0 inches Hg	
Title of Test		**Pressure**	**Notes**	
Design Load Test Negative Load		90.0 psf		
see appendix B				
Reading#	**Deflection**	**Permanent Set**	**Results**	**Add. Info**
1	0.595"	0.099"	Passed	
2	0.648"	0.093"	Passed	
3	0.604"	0.101"	Passed	

Sample: A-1	**Temperature:**	75.9°F	**Barometric Reading:** 30.0 inches Hg	
Title of Test		**Pressure**	**Notes**	
Design Load Test Negative Load		105.0 psf		
see appendix B				
Reading#	**Deflection**	**Permanent Set**	**Results**	**Add. Info**
1	0.681"	0.116"	Passed	
2	0.761"	0.118"	Passed	
3	0.707"	0.124"	Passed	

Sample: A-1	**Temperature:**	75.9°F	**Barometric Reading:** 30.0 inches Hg	
Title of Test		**Pressure**	**Notes**	
Design Load Test Negative Load		120.0 psf		
see appendix B				
Reading#	**Deflection**	**Permanent Set**	**Results**	**Add. Info**
1	0.771"	0.123"	Passed	
2	0.879"	0.132"	Passed	
3	0.769"	0.140"	Passed	

Sample: A-1	**Temperature:**	75.9°F	**Barometric Reading:** 30.0 inches Hg	
Title of Test		**Pressure**	**Notes**	
Design Load Test Negative Load		135.0 psf		
see appendix B				
Reading#	**Deflection**	**Permanent Set**	**Results**	**Add. Info**
1	0.861"	0.136"	Passed	
2	0.989"	0.149"	Passed	
3	0.853"	0.151"	Passed	

Sample: A-1	**Temperature:**	75.9°F	**Barometric Reading:** 30.0 inches Hg	
Title of Test		**Pressure**	**Notes**	
Design Load Test Negative Load		150.0 psf		
see appendix B				
Reading#	**Deflection**	**Permanent Set**	**Results**	**Add. Info**
1	0.906"	0.149"	Passed	
2	1.179"	0.164"	Passed	
3	0.915"	0.170"	Passed	

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

Sample: A-1	**Temperature:**	75.9°F	**Barometric Reading:** 30.0 inches Hg	
Title of Test		**Pressure**	**Notes**	
Design Load Test Negative Load		180.0 psf		
see appendix B				
Reading#	**Deflection**	**Permanent Set**	**Results**	**Add. Info**
1	0.957"	0.158"	Passed	
2	1.330"	0.180"	Passed	
3	1.005"	0.188"	Passed	

Sample: A-1	**Temperature:**	75.9°F	**Barometric Reading:** 30.0 inches Hg	
Title of Test		**Pressure**	**Notes**	
Design Load Test Negative Load		210.0 psf		
see appendix B				
Reading#	**Deflection**	**Permanent Set**	**Results**	**Add. Info**
1	0.986"	0.161"	Passed	
2	1.359"	0.184"	Passed	
3	1.108"	0.189"	Passed	

Appendix A

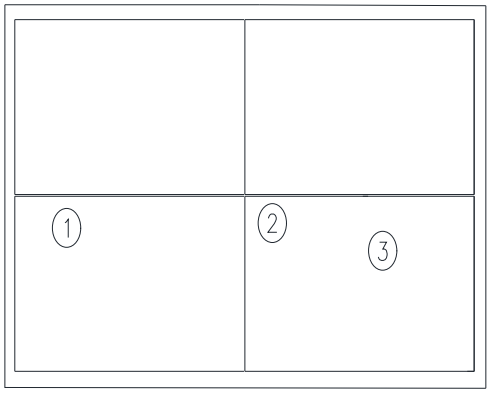

Appendix B

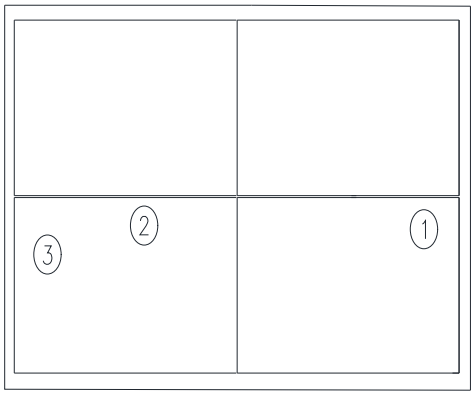

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.

DEKTON NOA TEST

-

STONE SHOP DRAWINGS
100% SET FOR REVIEW
SUBMITTAL #1 - SEPTEMBER 25, 2017
SUBMITTAL #2 - NOVEMBER 13, 2017

	FENESTRATION TESTING LABORATORY INC.
	LABORATORY NUMBER: 12519
	DATE: 4/13/2021
	DRAWINGS VERIFIED BY: LD

SHEET	DESCRIPTION
ST0.00	COVER PAGE
ST1.00	SPECIFICATION SHEET
ST2.00~ST2.05	ELEVATIONS, WALL SECTIONS, AND PLAN VIEWS
ST3.00~ST3.01	GRIDWORX RAIN SCREEN SECTION DETAILS
ST4.00~ST4.02	GRIDWORX RAIN SCREEN PLAN DETAILS

COPYRIGHT 2015 PRECISION WALL SYSTEMS, INC. - ALL RIGHTS RESERVED - PROTECTED UNDER U.S. PATENT No.8,051,623 B2 & 8,341,901 & 8,950,131. ADDITIONAL PATENTS PENDING.

DRAWN BY:

GRIDWORX®
STONE HANGING SYSTEM

PRECISION WALL SYSTEMS
10980 ALDER CIRCLE
DALLAS, TEXAS 75238

TEL: 214.774.4502
FAX: 214.432.5963

ARCHITECT:

N/A

PRECISION WALL SYSTEMS
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:

SECTION DETAILS

SHEET:

ST0.00

SPECIFICATIONS:

GRIDWORX FAMILY OF ANCHORS:
ALUMINUM ALLOY EXTRUSIONS WITH A COMPOSITION OF 6005 ALLOW WITH A T5 TEMPER. CHANNELS PROVIDED IN TWELVE FOOT (12') LENGTHS. "L BRACKETS" ARE SPECIFIED IN LENGTH BY THE CURTAIN WALL ENGINEER AND SET AT 1/4 POINTS OF PANEL WIDTH. ALUMINUM COMPONENTS OF THE GRIDWORX SYSTEM ARE ANODIZED WITH A CLEAR COAT OR WITH COLORED FINISHES OF AA M12C22A21 MEETING THE STANDARDS OF AAMA 611-98.

FASTENERS:

- STEEL STUDS:
  ELCO DRILL-FLEX OR HILTI KWIK-FLEX FASTENERS, #12 x 2" SELF DRILLING STRUCTURAL FASTENERS - SAE J 429 / GRADE 5 WITH A STALGARD COATING. INSTALLATION TO BE ON STUDS WITH MINIMUM OF 18 GAUGE SET ON 12" CENTERS.
- CMU OR CONCRETE:
  ELCO AGGRE-GATOR 300 SERIES STAINLESS STEEL THREADED CONCRETE ANCHOR, HEX HEAD, #12 x 2 1/4". INSTALLATION OF FASTENERS FOR THE "INTERMEDIATE T" TO BE ON 16" CENTERS WITH TOP AND BOTTOM SCREW TO ALTERNATE SO AS TO NOT HAVE BOTH INVADING THE SAME CAVITY OF THE CMU BLOCK. "TOP J AND STARTER J" TO BE INSTALLED ON 16" CENTERS.
- WOOD STUDS:
  STAINLESS STEEL 300, HEX HEAD, #12 x 2". TO BE INSTALLED ON 2" x 6" STUDS SET ON 16" CENTERS.

SHIMS:
FULL BEARING HI-INPACT RESISTANT PLASTIC OF 3" VERTICAL OR GREATER.

SEALANT:
DOW CORNING 790 SILICONE (OR EQUAL) WITH 3/8" OPEN CELL BACKER ROD.

FLASHING:

- HOHMANN & BARNARD, INC. X-SEAL TAPE ADHESIVE (OR EQUAL)
  APPLIED CONTINUOUSLY BEHIND ANCHOR ONTO SHEATHINFG?WATEPROOF MEMBRANE TO CREATE WATERTIGHT SEAL AROUND FASTENERS.
- METAL AND/OR ASPHALT FLASHING.
  MATERIAL PROVIDED BY OTHERS FOR INTER-STORY, CASEMENT, BASE, AND OTHER RELEVANT FLASHING APPLICATIONS.

ABBREVIATIOINS:

- F.O.S = FACE OF STONE
- F.O.GL = FACE OF GLASS
- E.O.S. = EDGE OF STONE
- G.L. = GRID LINE
- JT. = JOINT

ITEM #: F205
GRIDWORX 1/4" X 2-1/2" GRADE 5 STEEL FASTENER
FINISH: STALGARD COATING
MATERIAL: N/A

ISOMETRIC



PART #S C100 1/16", C101 1/8", C102 1/4"
FULL BEARING PLASTIC SHIM
FINISH: N/A
MATERIAL: HI-IMPACT PLASTIC



PART #
GRIDWORX 16 GAUGE FORMED ALUMINUM ANGLE
FINISH: G-90 COATING
MATERIAL: 6005 T5 ALUMINUM

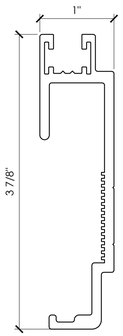

ITEM #: 570
GRIDWORX ULTRA 3.0 DEADLOAD ANCHOR
FINISH: MILL FINISH
MATERIAL: 6005 T5 ALUMINUM

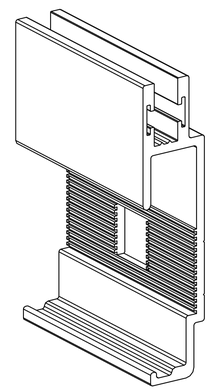

ISOMETRIC

FENESTRATION TESTING LABORATORY INC.
LABORATORY NUMBER: 12519
DATE: 4/13/2021
DRAWINGS VERIFIED BY: LD

PART # 3571820700750
SPAX 1/4" X 3" POWER LAG
FINISH: HCR COATING
MATERIAL: N/A

PART # 555 020 830
KEIL UNDERCUT ANCHOR
FINISH: N/A
MATERIAL: A4 STAINLESS STEEL

ISOMETRIC



ITEM #: 571
GRIDWORX ULTRA 3.0 WINDLOAD ANCHOR
FINISH: MILL FINSIH
MATERIAL: 6005 T5 ALUMINUM

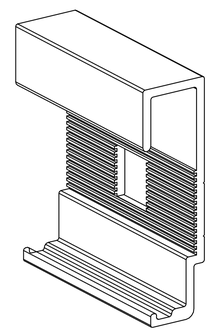

ISOMETRIC

PART #
GRIDWORX 5/16" 18-8 PITCH ADJUSTMENT BOLT
FINISH: BLACK FINISH
MATERIAL: STAINLESS STEEL

PART #
GRIDWORX 5/16" -18 THREAD PITCH ADJUSTMENT NUT
FINISH: N/A
MATERIAL: STAINLESS STEEL



ITEM #: 575
GRIDWORX ULTRA 3.0 LOCK WASHER
FINISH: MILL FINISH
MATERIAL: 6005 T5 ALUMINUM



ISOMETRIC

COPYRIGHT 2015 PRECISION WALL SYSTEMS, INC. - ALL RIGHTS RESERVED - PROTECTED UNDER U.S. PATENT No.8,051,623 B2 & 8,341,901 & 8,950,131. ADDITIONAL PATENTS PENDING.

DRAWN BY:
GRIDWORX® STONE HANGING SYSTEM
PRECISION WALL SYSTEMS
10980 ALDER CIRCLE
DALLAS, TEXAS 75238
TEL: 214.774.4502
FAX: 214.432.5963

ARCHITECT:
N/A

PRECISION WALL SYSTEMS
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:
SECTION DETAILS

SHEET:
ST1.00

COSENTINO NORTH AMERICA (MOCK UP #0)
DEKTON ULTRA COMPACT PANEL FACADE SYSTEM
NON IMPACT

FENESTRATION TESTING LABORATORY INC.
LABORATORY NUMBER: 12519
DATE: 4/13/2021
DRAWINGS VERIFIED BY: LD

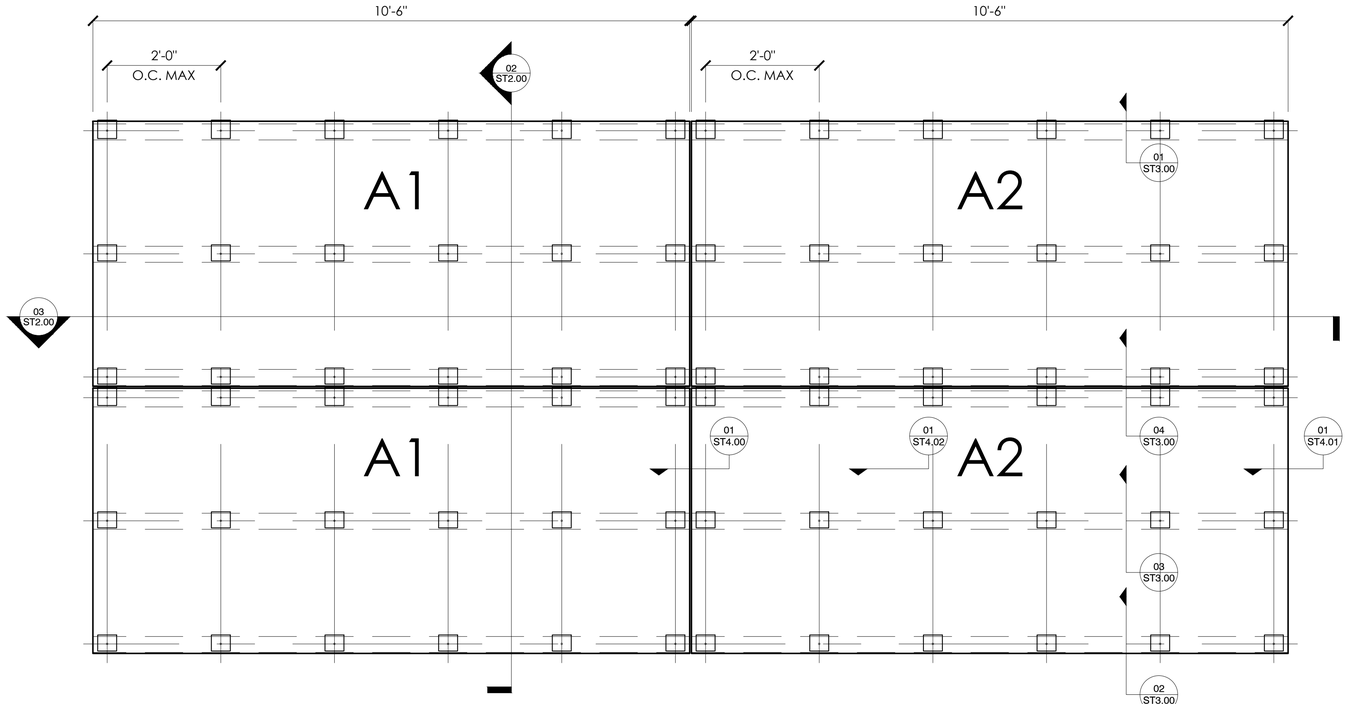

1 ST2.00 MOCK UP #0
ARCH. REF.: -
SCALE: 3/4" = 1'-0"

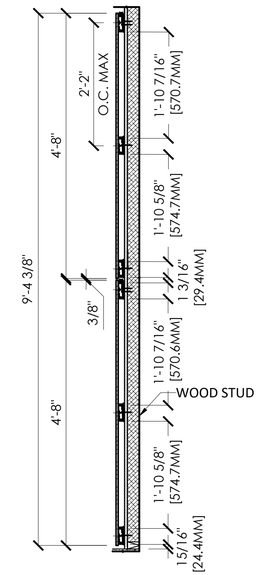

02 ST2.00 MOCK UP #0
SECTION VIEW
ARCH. REF.: -
SCALE: 3/4" = 1'-0"

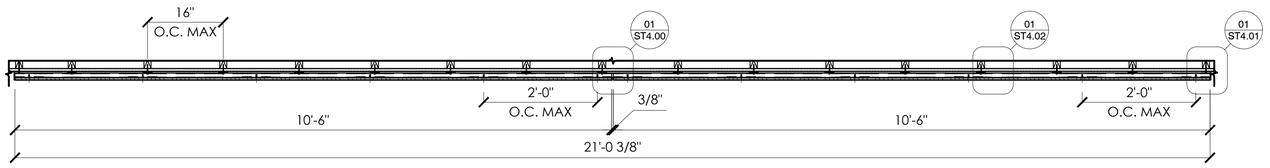

03 ST2.00 MOCK UP #0
PLAN VIEW
ARCH. REF.: -
SCALE: 3/4" = 1'-0"

TESTS:
UNIFORM LOAD (TAS 202) (LOADS ONLY)
CYCLIC LOAD (TAS 203)
SEE FLOWCHART FOR PRESSURES

COPYRIGHT 2015 PRECISION WALL SYSTEMS, INC. - ALL RIGHTS RESERVED - PROTECTED UNDER U.S. PATENT No.8,051,623 B2 & 8,341,901 & 8,950,131. ADDITIONAL PATENTS PENDING.

DRAWN BY:

GRIDWORX® STONE HANGING SYSTEM

PRECISION WALL SYSTEMS
10980 ALDER CIRCLE
DALLAS, TEXAS 75238

TEL: 214.774.4502
FAX: 214.432.5963

ARCHITECT:
N/A

PRECISION WALL SYSTEMS
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:
ELEVATIONS, SECTION, AND PLANS

SHEET:
ST2.00

FENESTRATION TESTING LABORATORY INC.

LABORATORY NUMBER: 12519

DATE: 4/13/2021

DRAWINGS VERIFIED BY: LD

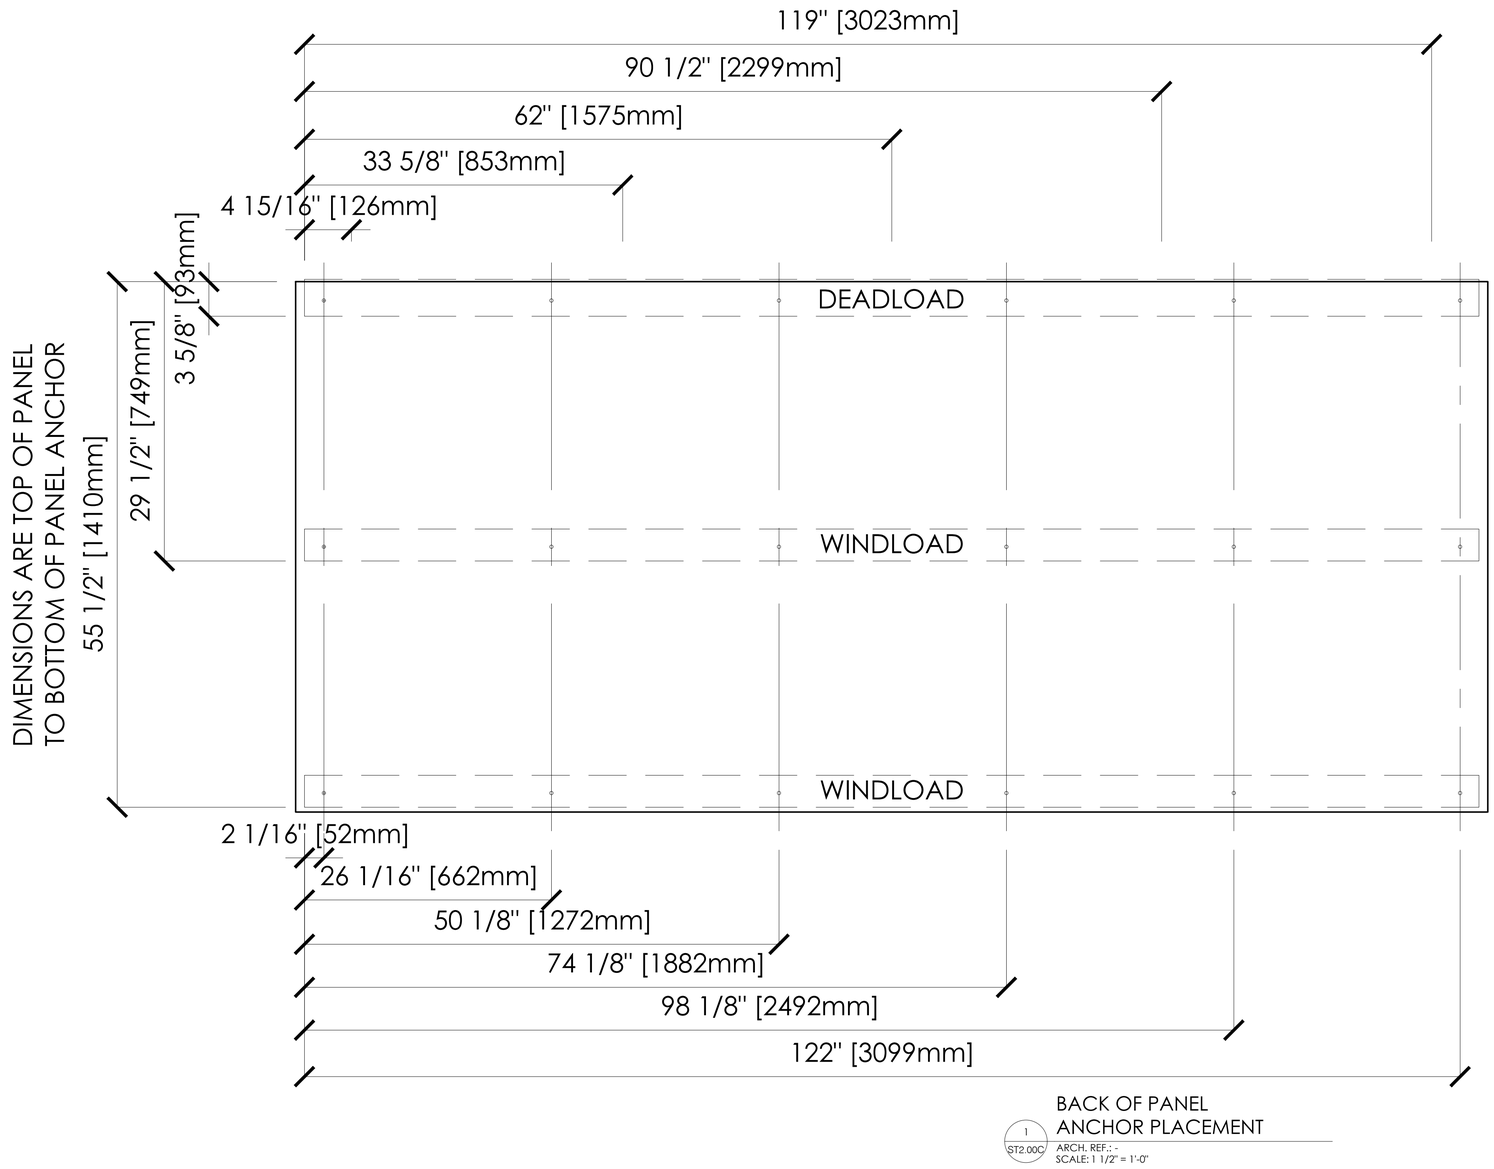

1 ST2.00C

BACK OF PANEL
ANCHOR PLACEMENT

ARCH. REF.: -
SCALE: 1 1/2" = 1'-0"

TESTS:
UNIFORM LOAD (TAS 202) (LOADS ONLY)
CYCLIC LOAD (TAS 203)
SEE FLOWCHART FOR PRESSURES

COPYRIGHT 2015 PRECISION WALL SYSTEMS, INC. - ALL RIGHTS RESERVED - PROTECTED UNDER U.S. PATENT No.8,051,623 B2 & 8,341,901 & 8,950,131. ADDITIONAL PATENTS PENDING.

DRAWN BY:

GRIDWORX® STONE HANGING SYSTEM

PRECISION WALL SYSTEMS
10980 ALDER CIRCLE
DALLAS, TEXAS 75238

TEL: 214.774.4502
FAX: 214.432.5963

ARCHITECT:
N/A

PRECISION WALL SYSTEMS
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:
ELEVATIONS, SECTION, AND PLANS

SHEET:
ST2.00C

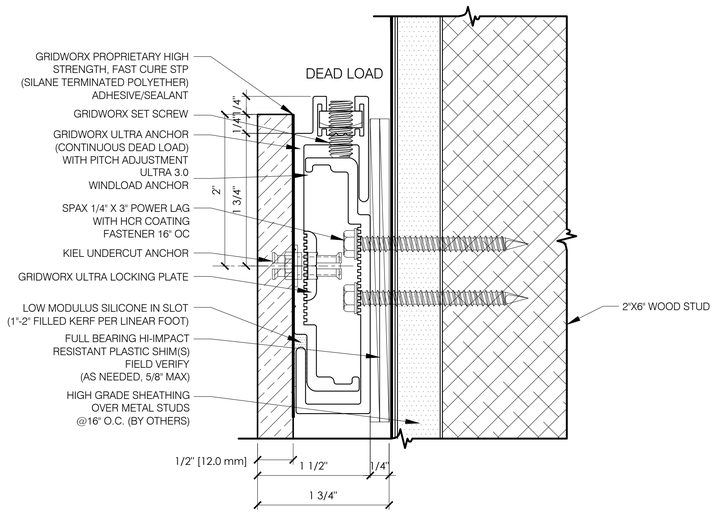

TOP ANCHOR
WITH WOOD SUBSTRATE

01 / ST3.02

ARCH. REF.: N/A
SCALE: 1'-0" = 1'-0"

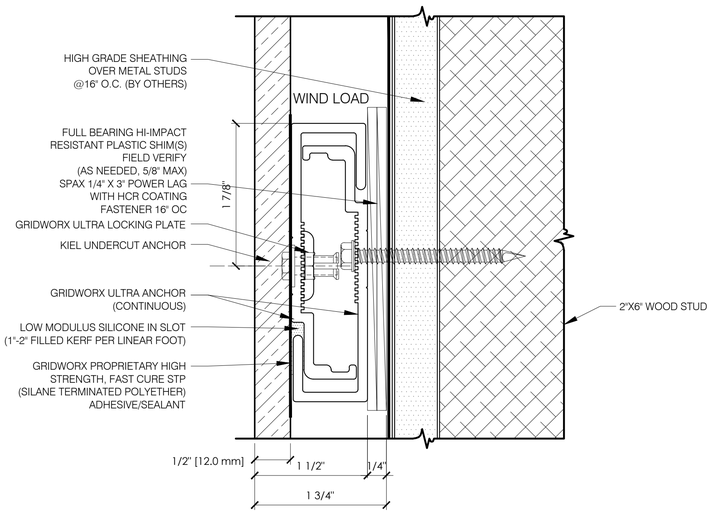

INTERMEDIATE SUPPORT
WITH WOOD SUBSTRATE

03 / ST3.00

ARCH. REF.: N/A
SCALE: 1'-0" = 1'-0"

FENESTRATION TESTING LABORATORY INC.
LABORATORY NUMBER: 12519
DATE: 4/13/2021
DRAWINGS VERIFIED BY: LD

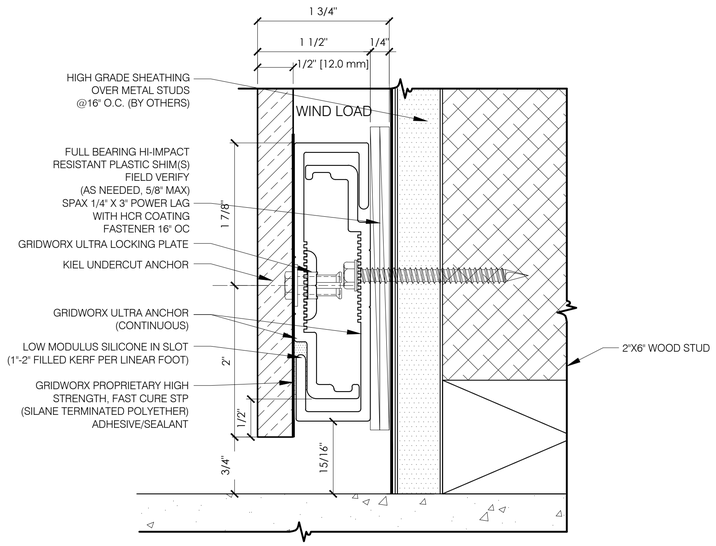

BOTTOM ANCHOR
WITH WOOD SUBSTRATE

02 / ST3.00

ARCH. REF.: N/A
SCALE: 1'-0" = 1'-0"

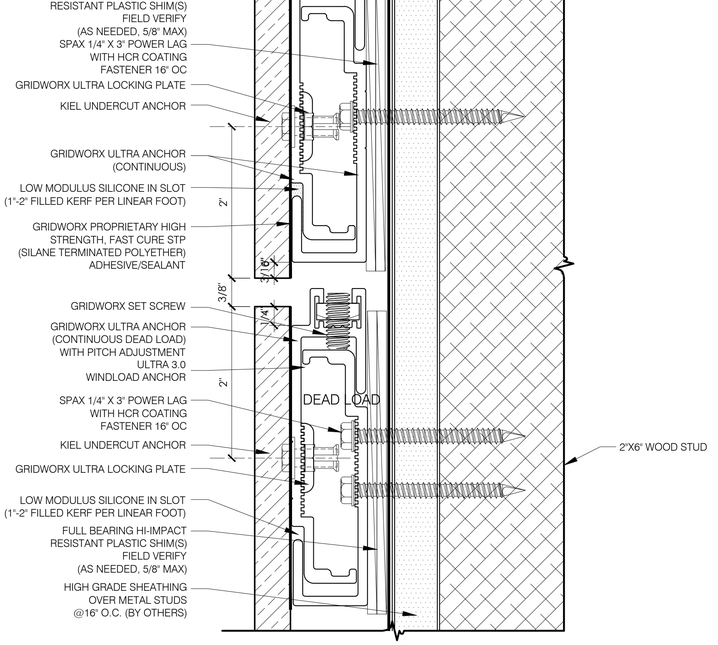

ANCHORS AT HORRIZONTAL
JOINT WITH WOOD SUBSTRATE

04 / ST3.00

ARCH. REF.: N/A
SCALE: 1'-0" = 1'-0"

COPYRIGHT 2015 PRECISION WALL SYSTEMS, INC. - ALL RIGHTS RESERVED - PROTECTED UNDER U.S. PATENT No.8,051,623 B2 & 8,341,901 & 8,950,131. ADDITIONAL PATENTS PENDING.

DRAWN BY:

GRIDWORX®
STONE HANGING SYSTEM

PRECISION WALL SYSTEMS
10980 ALDER CIRCLE
DALLAS, TEXAS 75238

TEL: 214.774.4502
FAX: 214.432.5963

ARCHITECT:

N/A

PRECISION WALL SYSTEMS
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:

SECTION DETAILS

SHEET:

ST3.00

FENESTRATION TESTING LABORATORY INC.

LABORATORY NUMBER: 12519

DATE: 4/13/2021

DRAWINGS VERIFIED BY: LD

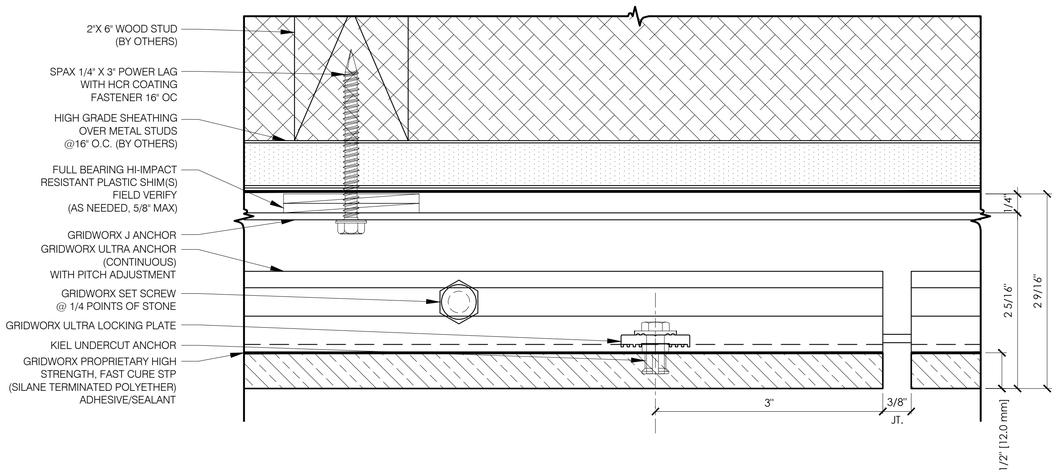

01 ST4.00

PLAN DETAIL AT STONE JOINT
WITH WOOD SUBSTRATE

ARCH. REF.: N/A
SCALE: 1'-0" = 1'-0"

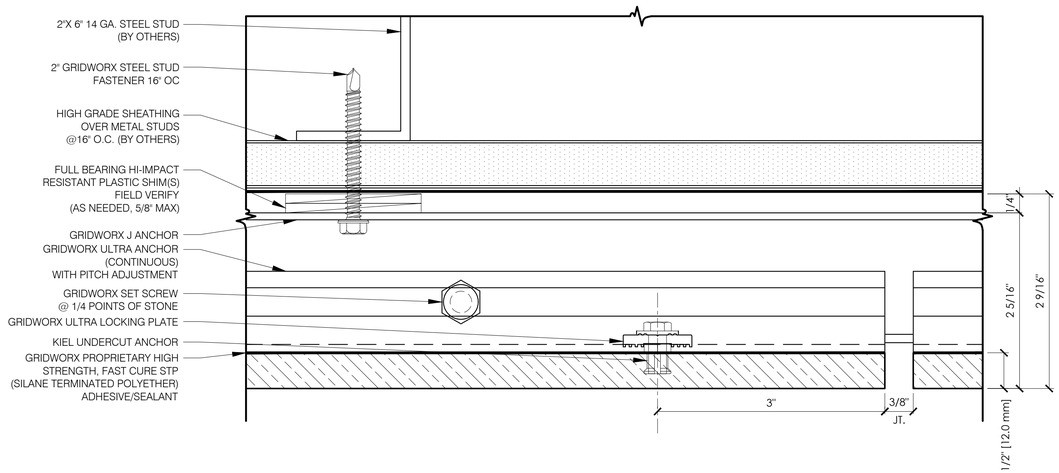

02 ST4.00

PLAN DETAIL AT STONE JOINT
WITH STEEL SUBSTRATE

ARCH. REF.: N/A
SCALE: 1'-0" = 1'-0"

COPYRIGHT 2015 PRECISION WALL SYSTEMS, INC. - ALL RIGHTS RESERVED - PROTECTED UNDER U.S. PATENT No.8,051,623 B2 & 8,341,901 & 8,950,131. ADDITIONAL PATENTS PENDING.

DRAWN BY:

GRIDWORX®
STONE HANGING SYSTEM

PRECISION WALL SYSTEMS
10980 ALDER CIRCLE
DALLAS, TEXAS 75238

TEL: 214.774.4502
FAX: 214.432.5963

ARCHITECT:

N/A

PRECISION WALL SYSTEMS
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:

SECTION DETAILS

SHEET:

ST4.00

	FENESTRATION TESTING LABORATORY INC.
	LABORATORY NUMBER: 12519
	DATE: 4/13/2021
	DRAWINGS VERIFIED BY: LD

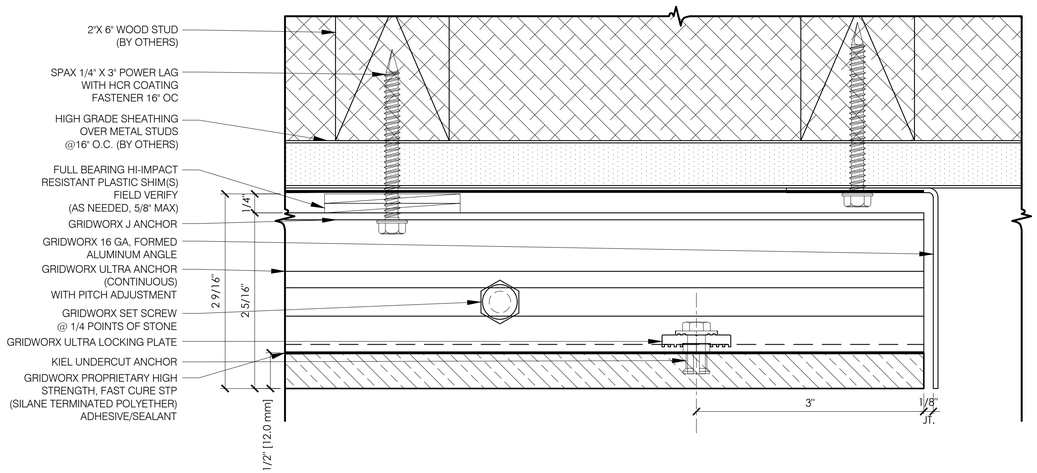

01 ST4.01

PLAN DETAIL AT STONE JAMB WITH WOOD SUBSTRATE

ARCH. REF.: N/A
SCALE: 1'-0" = 1'-0"

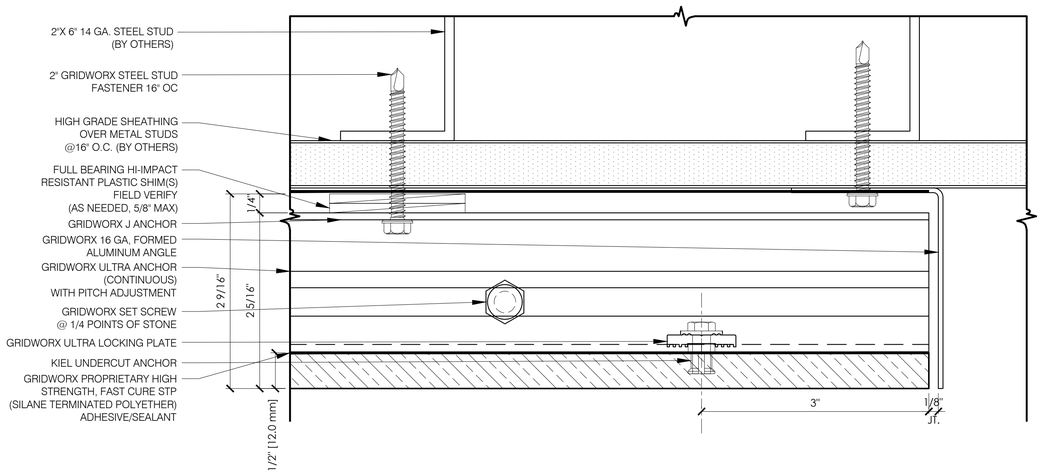

02 ST4.01

PLAN DETAIL AT STONE JAMB WITH STEEL SUBSTRATE

ARCH. REF.: N/A
SCALE: 1'-0" = 1'-0"

DRAWN BY:

GRIDWORX®
STONE HANGING SYSTEM

PRECISION WALL SYSTEMS
10980 ALDER CIRCLE
DALLAS, TEXAS 75238

TEL: 214.774.4502
FAX: 214.432.5963

ARCHITECT:

N/A

PRECISION WALL SYSTEMS
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:

SECTION DETAILS

SHEET:

ST4.01

COPYRIGHT 2015 PRECISION WALL SYSTEMS, INC. - ALL RIGHTS RESERVED - PROTECTED UNDER U.S. PATENT No.8,051,623 B2 & 8,341,901 & 8,950,131. ADDITIONAL PATENTS PENDING.

	FENESTRATION TESTING LABORATORY INC.
	LABORATORY NUMBER: 12519
	DATE: 4/13/2021
	DRAWINGS VERIFIED BY: LD

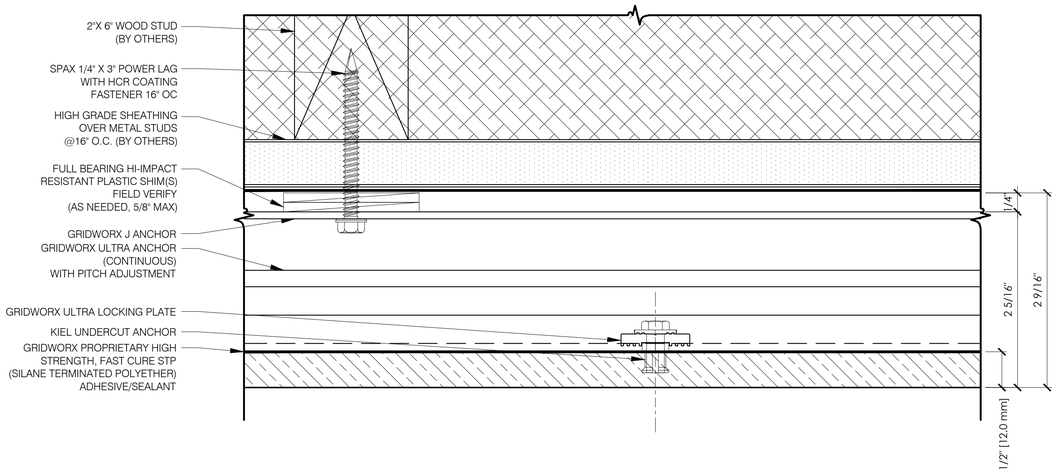

PLAN DETAIL AT INTERMEDIATE
ANCHOR WITH WOOD SUBSTRATE

01 / ST4.02

ARCH. REF.: N/A
SCALE: 1'-0" = 1'-0"

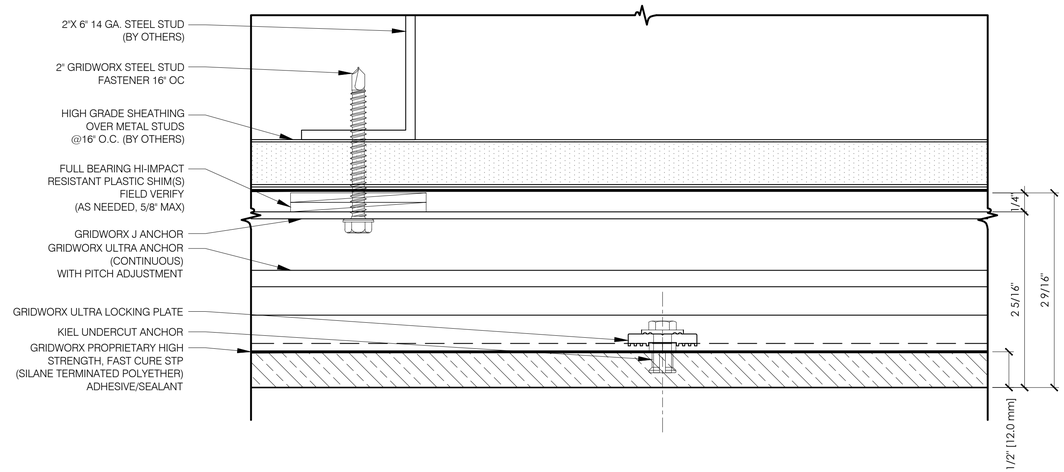

PLAN DETAIL AT STONE INTERMEDIATE
ANCHOR WITH STEEL SUBSTRATE

02 / ST4.02

ARCH. REF.: N/A
SCALE: 1'-0" = 1'-0"

COPYRIGHT 2015 PRECISION WALL SYSTEMS, INC. - ALL RIGHTS RESERVED - PROTECTED UNDER U.S. PATENT No.8,051,623 B2 & 8,341,901 & 8,950,131. ADDITIONAL PATENTS PENDING.

DRAWN BY:

GRIDWORX®
STONE HANGING SYSTEM

PRECISION WALL SYSTEMS
10980 ALDER CIRCLE
DALLAS, TEXAS 75238

TEL: 214.774.4502
FAX: 214.432.5963

ARCHITECT:

N/A

PRECISION WALL SYSTEMS
10980 ALDER CIR. DALLAS, TX 75238

SHOP DRAWINGS

DATE:

NOTES:

TITLE:

SECTION DETAILS

SHEET:

ST4.02